



U-BOLT SHAPED TO FIT ANY DESIGNATED STEEL POST


WITH STEEL POSTS

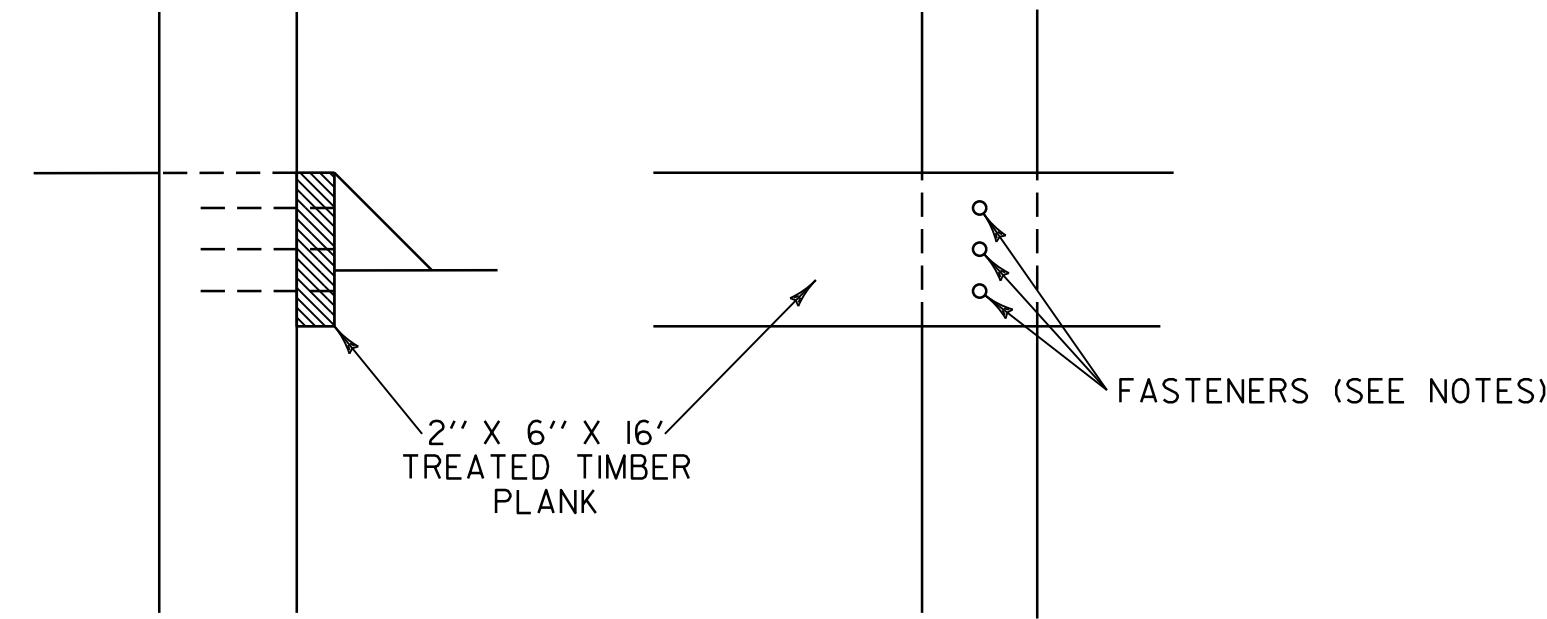


WITH WOOD POSTS (EXISTING CONDITION)

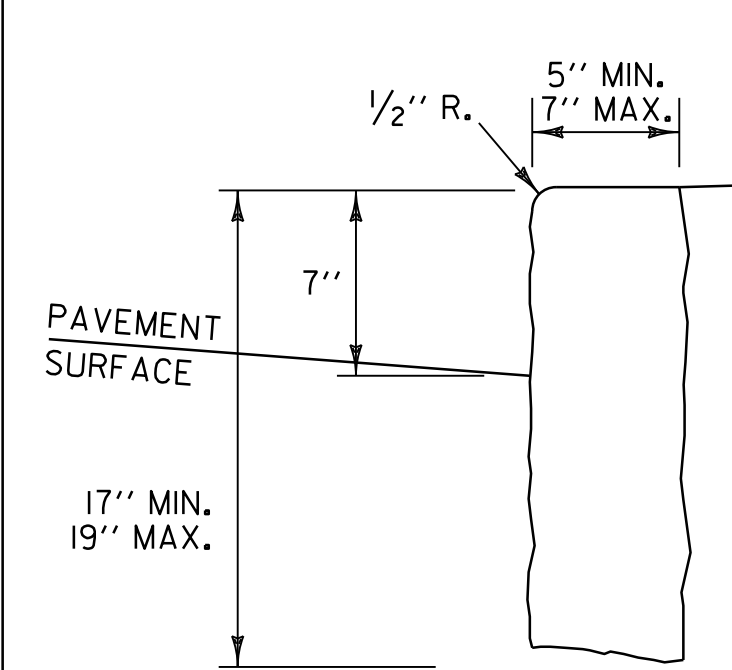


VERTICAL GRANITE CURB

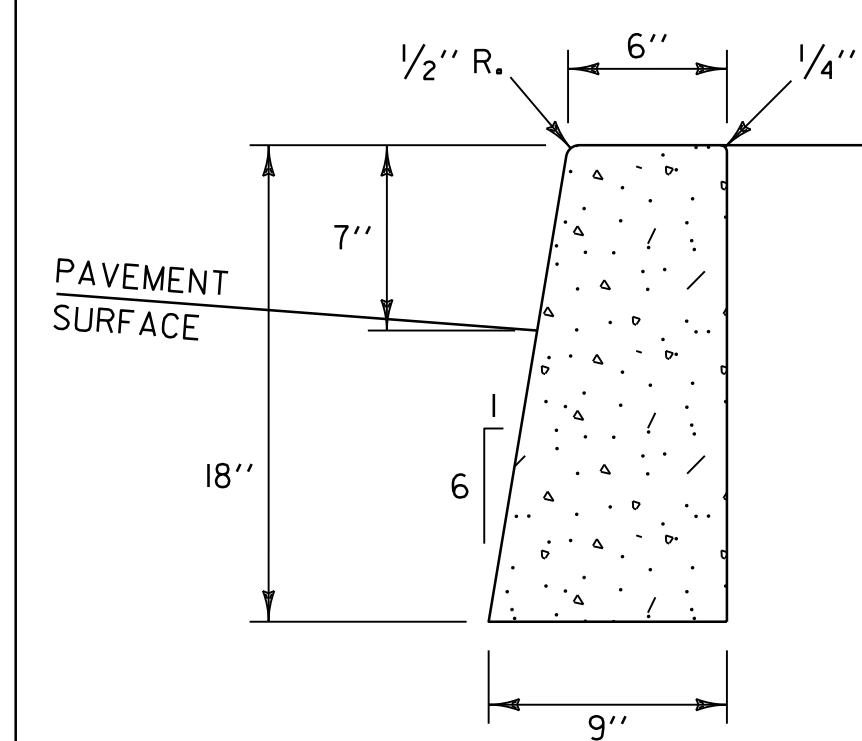

CAST-IN-PLACE CONCRETE CURB, TYPE B

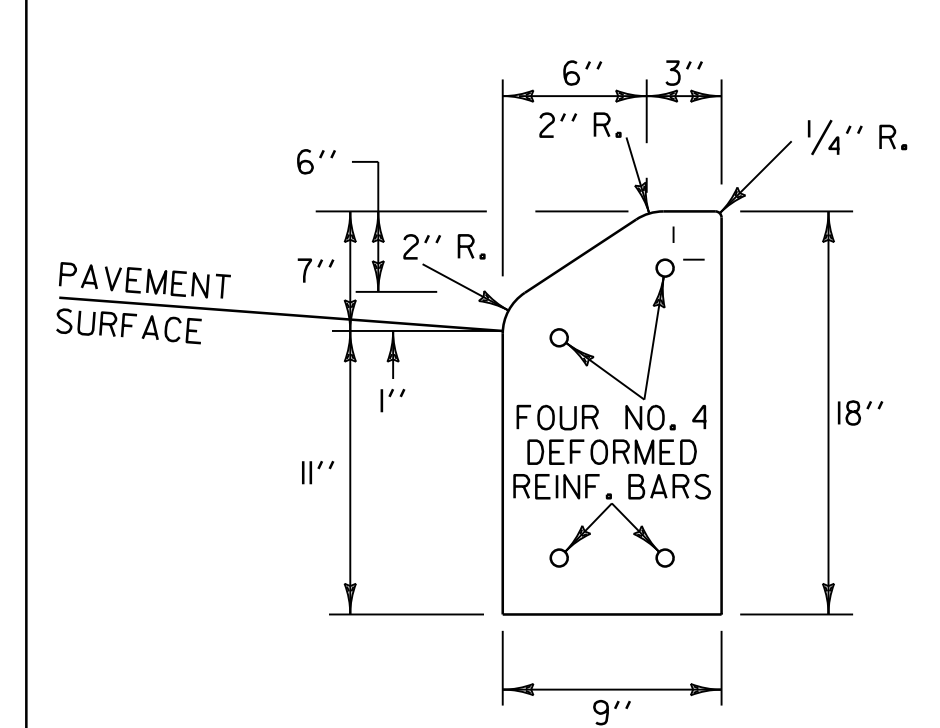


PRECAST REINFORCED CONCRETE CURB, TYPE A

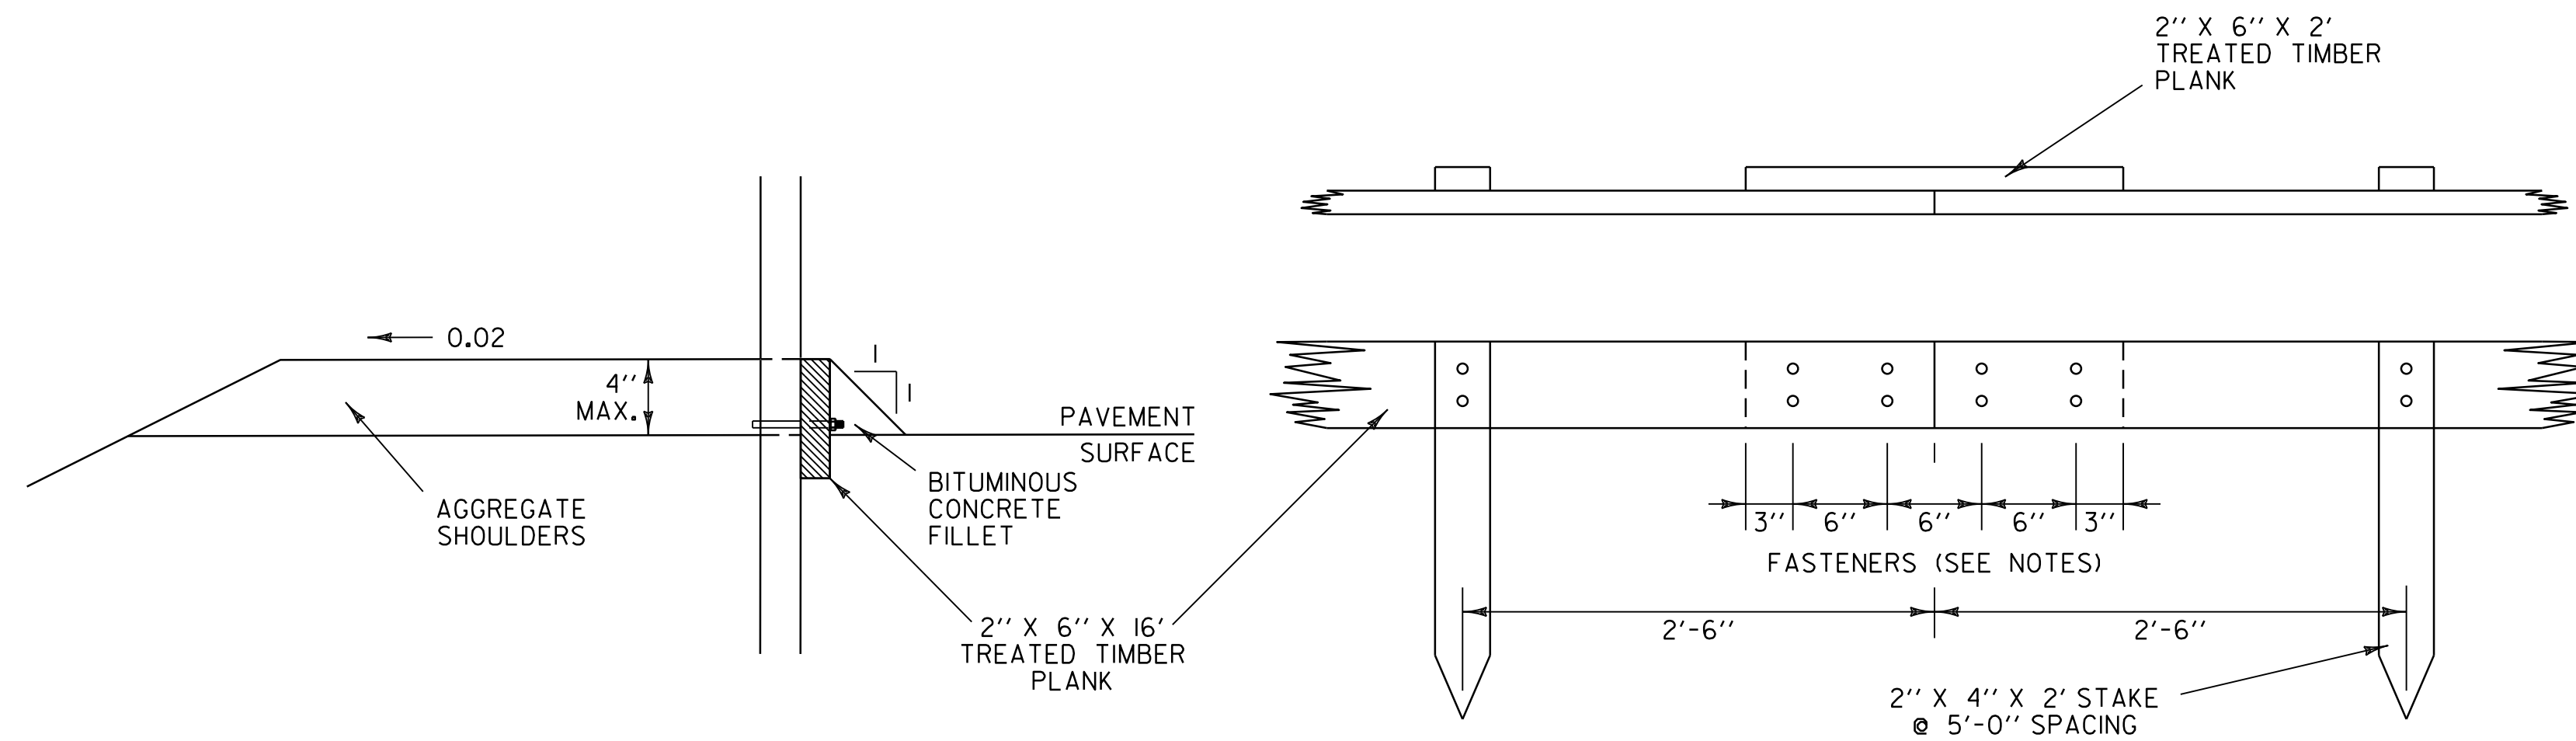

BITUMINOUS CONCRETE FILLET DETAIL


TREATED TIMBER CURB

SPLICE DETAIL

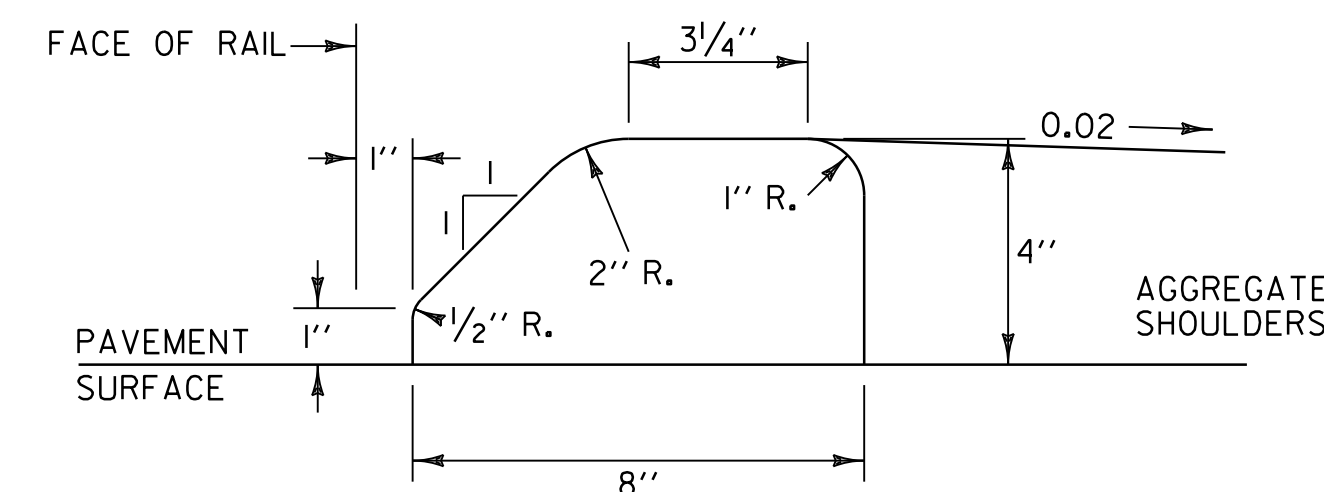


USE ONLY WITH STEEL BEAM GUARDRAIL


BITUMINOUS CONCRETE CURB, TYPE A

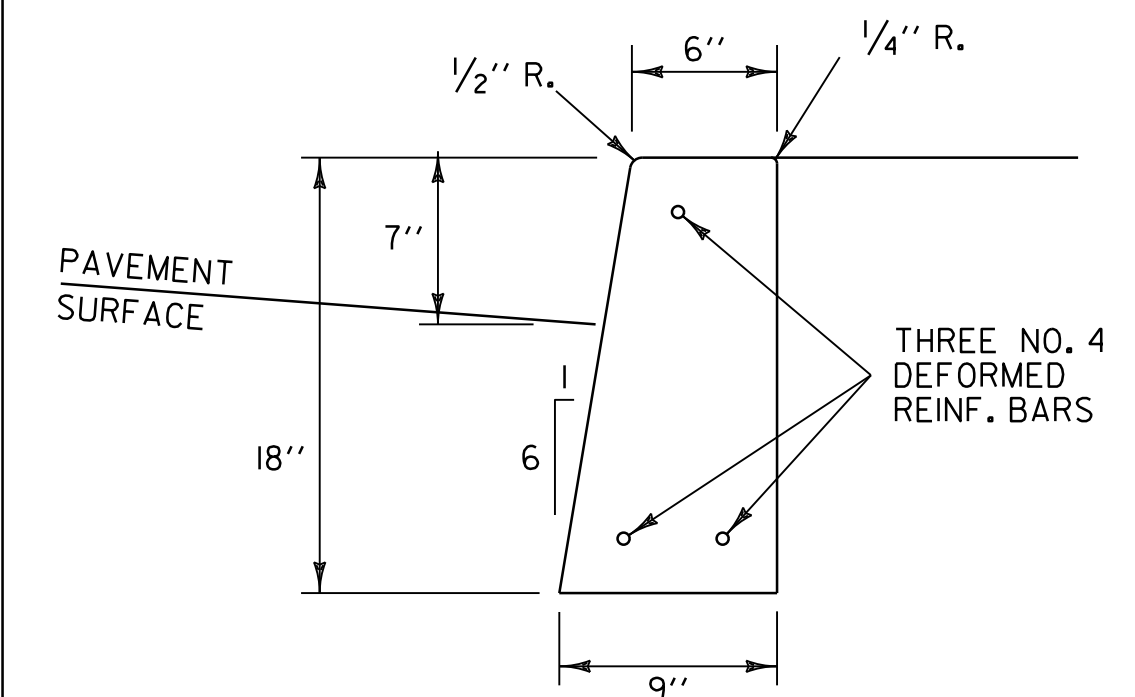


PRECAST REINFORCED CONCRETE CURB, TYPE B

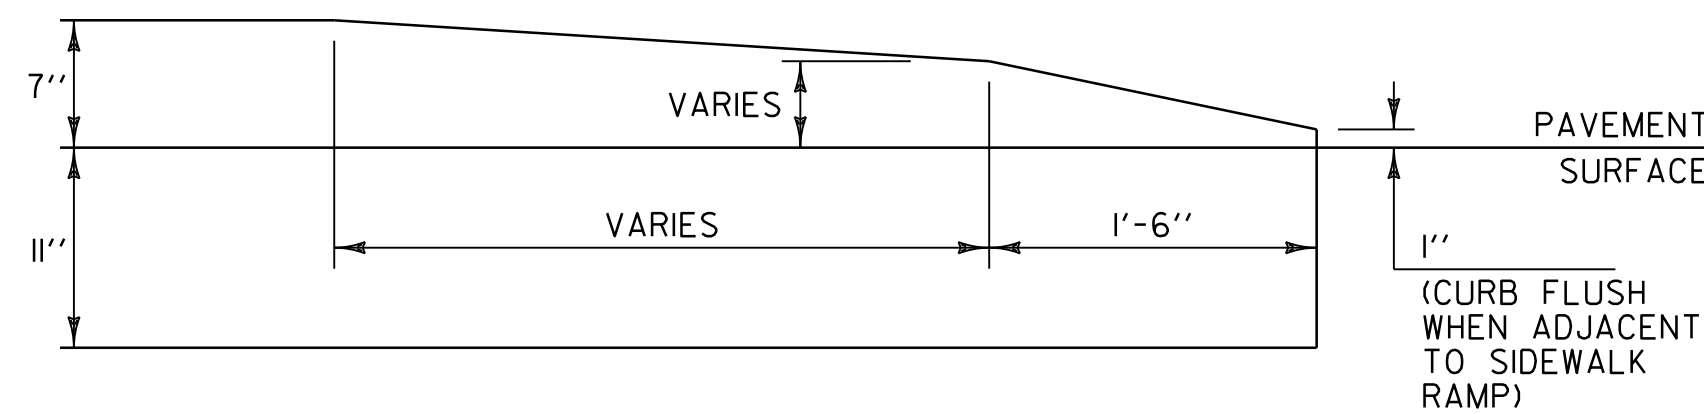

CONCRETE CURB END

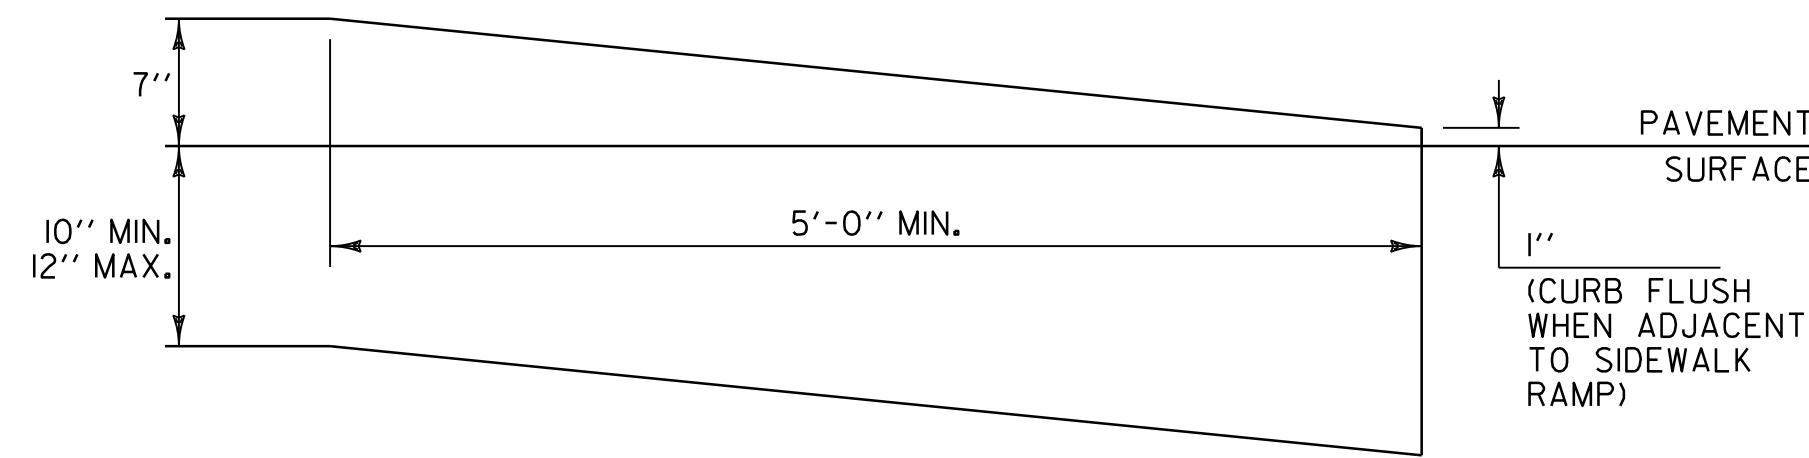

VERTICAL GRANITE CURB END

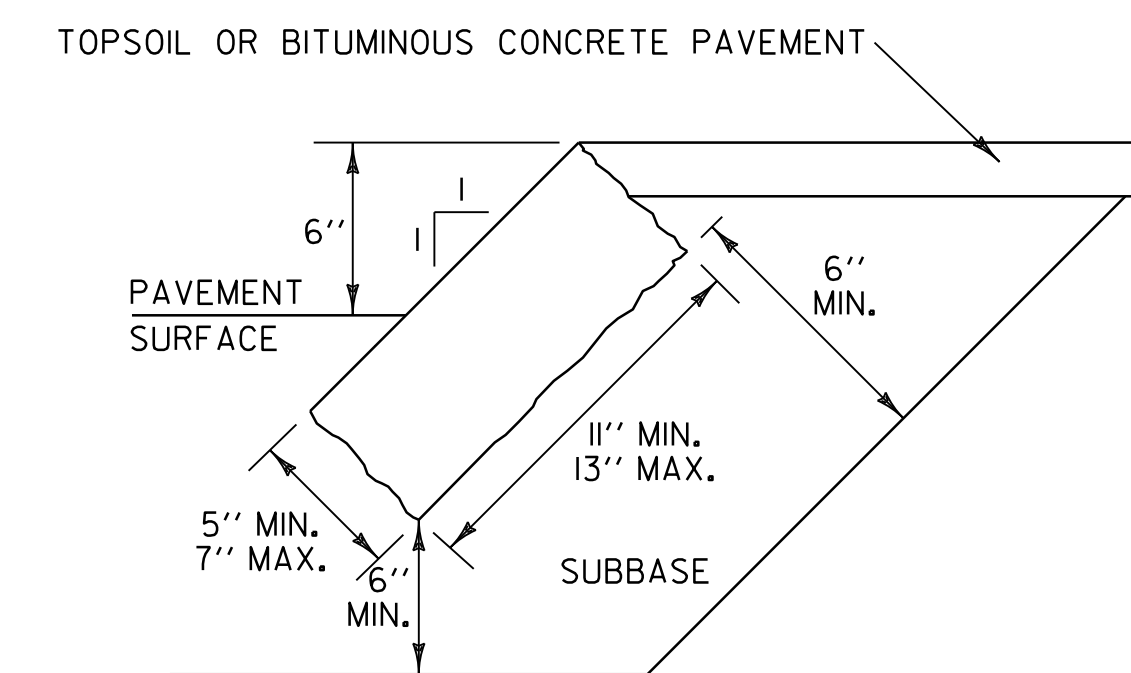

EDGING TO BE PLACED PRIOR TO PLACING TOP SURFACE COURSE.


GRANITE SLOPE EDGING

GENERAL NOTES

- HEIGHT OF REVEAL OF CURB SHALL NOT EXCEED FOUR INCHES WHERE DESIGN OR POSTED SPEED IS EQUAL TO OR GREATER THAN 40 MPH AND WHEN INSTALLED WITH GUARDRAIL (STANDARD SHAPE TO BE BURIED TO THIS DEPTH).
- WHEN CONCRETE SIDEWALK IS CONSTRUCTED ADJACENT TO CONCRETE OR VERTICAL GRANITE CURB, ASPHALT TREATED FELT SHALL BE PLACED BETWEEN THE SIDEWALK AND CURB FOR THE TOTAL DEPTH OF THE SIDEWALK.
- FASTENERS (20d NAILS OR SCREWS) SHALL BE CORROSION RESISTANT TO THE TREATED LUMBER.
- FOR SPECIFICATIONS FOR EXPANSION/CONTRACTION JOINTS AND LENGTHS OF SECTIONS, SEE SECTION 616.
- JOINTS BETWEEN CURB SECTIONS SHALL BE MORTARED IN CONFORMANCE WITH SECTION 616.
- BITUMINOUS CONCRETE AND TREATED TIMBER CURB SHALL BE IN CONFORMANCE WITH SECTION 616.
- TWO INCH MINIMUM CLEARANCE FROM FACE OF CONCRETE TO EDGE OF REINFORCING STEEL.
- WHEN CONSTRUCTING CAST-IN-PLACE CONCRETE CURB, TYPE A, FOLLOW THE DIMENSIONS OF PRECAST REINFORCED CONCRETE CURB, TYPE A, BUT OMIT THE REINFORCING BARS.

REV.	DATE	DESCRIPTION
0	FEB. 11, 2008	ORIGINAL APPROVAL
1	FEB. 17, 2022	NOTE REVISIONS
OTHER STANDARDS REQUIRED: NONE		
VTRANS AND FHWA APPROVAL ON FILE WITH CONTRACT ADMINISTRATION		

CURBING

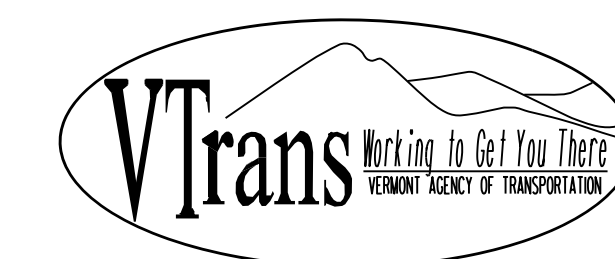

STANDARD
C-10