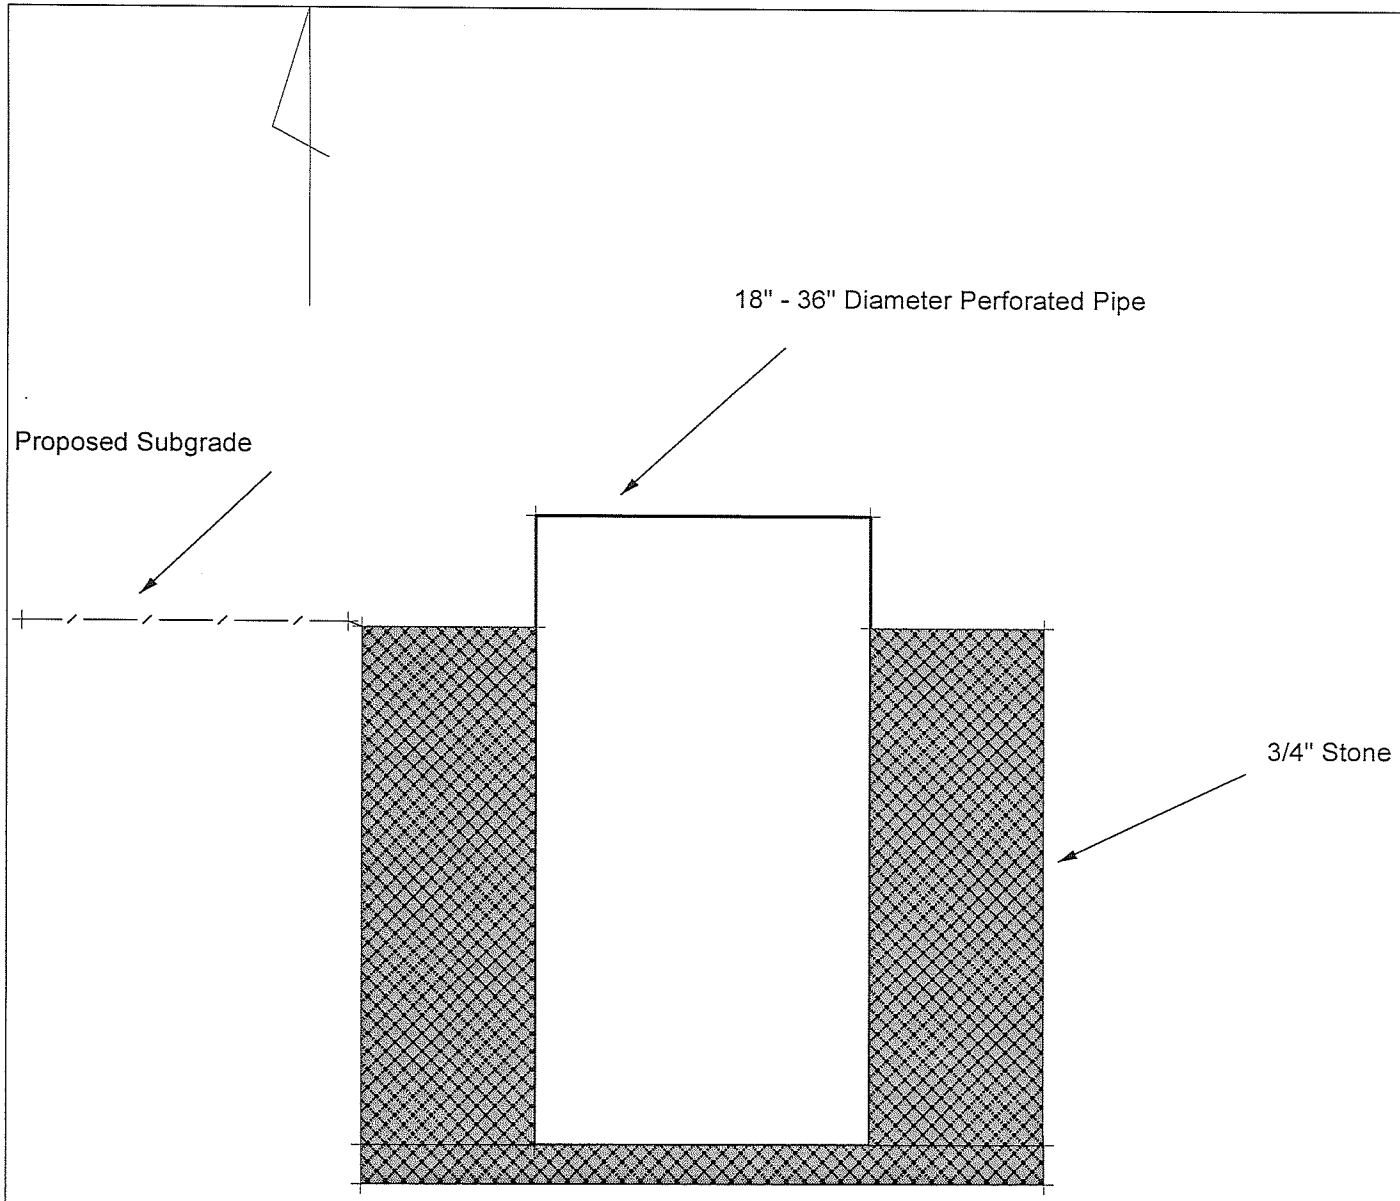

N.T.S

Notes:

1. Bottom of sump pipe will be a minimum of 3' below grade.
2. 12" to 18" of 3/4" stone will be used to surround the sump pipe.
3. Pump sizing will be addressed accordingly based upon conditions at the time of dewatering.
4. Dewatering inside of the cofferdam may require muliple sump locations. This will be determined in the field.