

MONOKO, LLC

1037 Peninsula Avenue
Tarpon Springs, FL 34689-2125
E-mail Address: MonokoLLC@aol.com

(727) 940-3244
(727) 279-8795 Fax

Submittal No.: 03a: Containment Plan Calculations sealed by VT PE

Date: June 14, 2016

Vermont Department of Transportation
Southeast Regional Construction Office
Attn: Ann Gammell, P.E., Regional Construction Engineer
PO Box 1873; 61 Depot Street
Wilder, VT 05088-1873
(802) 522-5719; (802) 281-5000; (802) 281-5002 fax
Ann.Gammell@Vermont.gov

Description: Proposal/Contract Number: Windsor-Hartford IM BPNT (13)
Letting Date: 10/09/15; Award Date: 11/02/15
Project Description: Bridge Painting of Eleven Bridges
In the Towns of Windsor & Hartford, Windsor County, VT
Contract Amount: \$8,671,323.00; Completion Date: 10/12/18

Contractor: MONOKO, LLC

Reviewed & Approved By: *Keri Monokandilos*
Keri Monokandilos, Manager

Date: 06/14/2016

Engineer: Paul Perry IV, Resident Engineer
PO Box 1873; 61 Depot Street
Wilder, VT 05088-1873
802-498-8255 cell; 802-281-5000 office; 802-281-5002 fax
paul.perry@vermont.gov
mark.sargent@vermont.gov
pmcdonald@gpinet.com
ann.gammell@vermont.gov

Revision:

**ABRASIVE BLASTING CONTAINMENT PLANS
ELEVEN BRIDGES ON I-91
BRIDGE NOS. 34N, 34S, 41N, 41S, 41C, 42N, 42S, 44N, 44S, 45N & 45S**

Windsor-Hartford

County of Windsor, Vermont

Table of Contents

Appendix A: Structural ImpactA1
Appendix B: Platform Design.....B1
Appendix C: Scaffold DesignC1
Appendix D: Miscellaneous HardwareD1
Appendix E: Standard Wire Rope.....E1
Appendix F: Scaffold PlatformsF1
Appendix G: Ventilation SystemG1

Prepared for:

Monoko, LLC
1037 Peninsula Avenue
Tarpon Springs, FL 34689
(727) 940 - 3244

June, 2016

A2B Engineering, LLC



Paul R. Steijlen, P.E.
VT License No. 107795

Appendix A

Structural Impact

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

Structural Impact:

The platform containment structure has been analyzed for a live load of 16 psf (Approximately 0.5 in. average depth of steel shot, 1.5" mineral slag abrasive or 1.5" sand abrasive plus uniform worker loading). When the depth of the spent abrasives nears the depths specified, the contractor will cease abrasive blasting operations and vacuum the spent abrasives.

The scaffold structure has been analyzed for approximately 1/4" average depth of steel shot. The configuration of the scaffold was taken to be 32 feet by 28 inches (max) with a 2 person, 500 lb rated scaffold.

Design Loads:

Platform Design Criteria:

Dead Load =	<u>3</u> psf	(Platform)
Live Load (Uniform) =	<u>12</u> psf	(0.5 in. steel shot)
Live Load (Uniform) =	<u>4</u> psf	(2 workers)

Scaffold Design Criteria:

Length =	<u>32</u> ft	(max per scaffold)
Width =	<u>28</u> in	(max per scaffold)
Dead Load =	<u>220</u> lb	(scaffold)
Weight of steel shot =	<u>6</u> psf	(0.25 in. steel shot)
Live Load (Concentrated) =	<u>250</u> lb	(per worker)

No more than 2 workers shall be allowed per platform cable or scaffold cable. Limit 500 lb. total weight of workers and abrasive blasting on 500 lb. rated scaffold

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

Wind Loads:

The containment structure has been analyzed for a maximum wind velocity of 40 mph. If winds nearing or exceeding 40 mph (or a lesser wind is specified in the contract specifications) are predicted, blasting and painting operations shall cease, and the paint containment tarpaulins shall be rolled and secured in place.

Design Variables:

Height to C.G. of Cont. Area = 20 ft

Height and Exposure Factor $K_z = 1.0$
 (ASCE 7-10 Table 17.3-1, z = 50 ft, Exposure C)

Topographic Factor $K_{zt} = 1.0$
 (ASCE 7-10 Figure 26.8-1)

Wind Directionality $K_d = 0.85$
 (ASCE 7-10 Table 26.6-1, Building C & C)

Wind Velocity V = 40 mph

Wind Pressure $P_z = 0.00256 * K_z * K_{zt} * K_d * V^2$ (psf)

Wind Pressure $P_z = 3.48$ psf

Design Pressure:

Height of Cont. Area = 50 ft (Conservative)

Wind Pressure = Height * $P_z = 175.0$ plf

NOTE:

Based on the maximum wind velocity of 40 mph (8 psf wind load per AASHTO), the resulting load transferred to a bridge structure is 175 plf, based on a containment height of 50 ft. from the top of the bridge parapets to grade. Since AASHTO 3.15.1.1.2 specifies a lateral loading of 300 plf minimum, for design of girder bridges and 450 plf for truss bridges, the maximum anticipated load of 175 plf is acceptable. Therefore, wind loading on girder bridges does not govern.

Appendix B

Platform Design

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

Platform Cable Design Summary (Metal Decking):

Option #	Platform Cable Size (in.)	Platform Support Hanger (in.)	Max. Platform Support Hanger Spacing	Max. Platform Cable Spacing	Platform Cable Load Ratio	Platform Support Hanger Load Ratio	Chain Hanger Load Ratio	Maximum Shackle Load Ratio	Overall Design Check
2	9/16	3/8	25.00	5.25	1.01	1.00	1.89	1.21	OK

Option # 1

Platform Cable Size =	<u>9/16</u> in.
Minimum Support Hanger Size =	<u>3/8</u> in.
Maximum Support Hanger Spacing =	<u>25</u> ft.
Maximum Cable Spacing =	<u>5.25</u> ft.
Minimum Shackle Size =	<u>1/2</u> in. (for Platform Support Hangers)
Minimum Shackle Size =	<u>5/8</u> in. (for Platform Cables)
Design Cable Sag =	<u>18</u> in.



Subject: Abrasive Blasting Containment Plans		
Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____
Check by: PRS	Job No: 187-18-1	

Suspended Platform System Design (Metal Decking with 0.5625 in. dia. Platform Cable @ 5.25 ft. spacing):

1 Bridge Structure:	Max. Hanger Spacing	25.00 ft.
2 Worker Loading:	Tributary cable width	5.25 ft. maximum (Conservative)
	No. workers / platform cable	2 (250 lb. ea. OSHA)
	Equiv. worker loading	3.81 psf
3 D+L Loading:	Metal Decking	3.00 psf
	18-oz floor tarpaulins	0.13 psf
	Dead Load =	3.13 psf
	Dead Load (min) =	3.00 psf
	Dead Load =	3.13 psf
	Assume depth of grit =	1/2 in
	Uniform grit loading	12.00 psf 1/2 in. layer
	Equiv. worker loading	4.00 psf 2 workers
	Live Load =	16.00 psf (Grit + Worker Loading)
	Total Design Loading (Service)	19.13 psf
	Total Design Loading (Ultimate)	114.75 psf (Using FS = 6)
4 Platform Cable Analysis:	Platform Cable Size	9/16 in. dia. 6x19 IWRC, EIP
(Longitudinals)	Platform Cable Weight	0.59 plf
	Platform Cable strength.	16.80 tons
	Platform Cable strength.	16.30 tons (pre-tensioned with 1000 lbf)

Max. tension at center of cable span, $H = w L^2 / 8 d$		
Uniform cable load,	w =	603.0 plf
Max. cable span,	L =	25.00 ft.
Min. req'd deflect,	d =	15.0 in (5% of length and 12 inch min.)
Use =	d =	18.0 in
Tension (center)	H =	15.70 tons

Max. tension at end supports, $T = [H^2 + (w L / 2)^2]^{0.5}$		
Design Cable Tension =		16.15 tons
Cable Stress Ratio		1.01 >= 1.0 OK
Use Shackle Size =		5/8 in
Working Load limit =		3.25 tons
Factor of Safety =		6
Shackle Strength =		19.5 tons
Design Load at supports =		16.15 tons
Shackle Load Ratio =		1.21
Shackle Check =		OK



Subject: Abrasive Blasting Containment Plans		
Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____
Check by: PRS	Job No: 187-18-1	

5 Platform Support Hangers Analysis:

Max. tributary hanger area..	131.3 sq.ft.
Max. hanger load,	15061 lbf
Max. hanger load,	7.53 tons
Platform Support Hangers	3/8 in. dia. 6x19 IWRC, EIP (min)
Platform Support Hangers Weight	0.26 plf
Platform Support Hangers Strength	7.55 tons
Hanger Stress Ratio	1.00 >= 1.0 OK

Min. Chain Working Load	7100 lb (min)
Factor of Safety	4
Chain Strength	14.2 tons
Design Load at supports =	7.53 tons
Chain Hanger Stress Ratio =	1.89 >= 1.0 OK

Use Shackle Size =	1/2 in
Working Load limit =	2.00 tons
Factor of Safety =	6
Shackle Strength =	12 tons
Design Load at supports =	7.53 tons
Shackle Load Ratio =	1.59
Shackle Check =	Ok

6 Outrigger Loads:

Tension (center) =	15.70 tons (Includes F.S. of 6)
Horiz. Distance to 1st Outrigger =	25 ft.
Vertical Distance =	1.79 ft.
Horizontal Distance =	6 ft.
Vertical Angle =	4.10 deg
Horizontal Angle =	13.50 deg
Vertical Force at 1st Outrigger =	0.37 kips (Service Load)
Horizontal Force at 1st Outrigger =	1.22 kips (Service Load)

Tension (center) =	15.70 tons (Includes F.S. of 6)
Horiz. Distance to 2nd Outrigger =	25 ft.
Vertical Distance =	1.79 ft.
Horizontal Distance =	9 ft.
Vertical Angle =	4.10 deg
Horizontal Angle =	19.80 deg
Vertical Force at 2nd Outrigger =	0.37 kips (Service Load)
Horizontal Force at 2nd Outrigger =	1.77 kips (Service Load)

Note: See RAM Elements Analysis for Outrigger Design

Alternate Support Hanger Analysis:

1. Bridge Configuration:

- | | | |
|--------------------------------|-----------|----------------|
| a. Flange Plate Width, w = | 12.00 in. | (Conservative) |
| b. Flange Plate Thickness, t = | 13/16 in. | (Conservative) |
| c. Fy (A36) = | 36 ksi | |

2. D+L Loading:

- | | | |
|---------------------------|-----------|-------------------------|
| e. Dead Load = | 3.13 psf | (min. platform loading) |
| f. Live Load = | 16.00 psf | (Grit + Workers) |
| g. Total Design Loading = | 19.13 psf | (e + f) |

3. Hanger Loads:

- | | | |
|--|------------------------|----------------|
| h. Max Girder Spacing = | 7.50 ft | |
| i. Max Diaphragm Spacing = | 25.00 ft | (Conservative) |
| j. Max. Tributary Hanger Area = | 187.50 ft ² | (h * i) |
| k. (1) Additional Worker at ea. Hanger = | 250.00 lb | (conservative) |
| l. Maximum Hanger Load, P = | 3.84 kips | (g * j) + k |

4. Analysis:

- | | | |
|----------------------------|----------------------|---------------------------------|
| m. Eccentricity, v = | 6.0 in. | |
| n. Moment, Mmax = | 11.51 k-in | (l / 2 * m) |
| o. Section Modulus, S = | 1.32 in ³ | (1/6 * 2 * m * b ²) |
| p. fb = (Mmax) / Sx | 8.72 ksi | |
| q. Fb = 0.66 * Fy = | 23.76 ksi | |
| r. Capacity/Demand Ratio = | 2.73 | |

Check: Ok

NOTE:

$$M = (l / 2 * k)$$



$$S = (1/6 * 2 * k * b^2)$$

$$M/S = 1.5 * l / b^2 \leq 0.66 * Fy$$

$$b \geq \text{SQRT}(1.5 * l / (0.66 * Fy))$$

- | | | |
|----------------------------------|-----------|-----|
| r. Flange Plate Thickness = | 13/16 in. | (b) |
| s. Min. Flange Plate Thickness = | 0.49 in. | |

Check: Ok

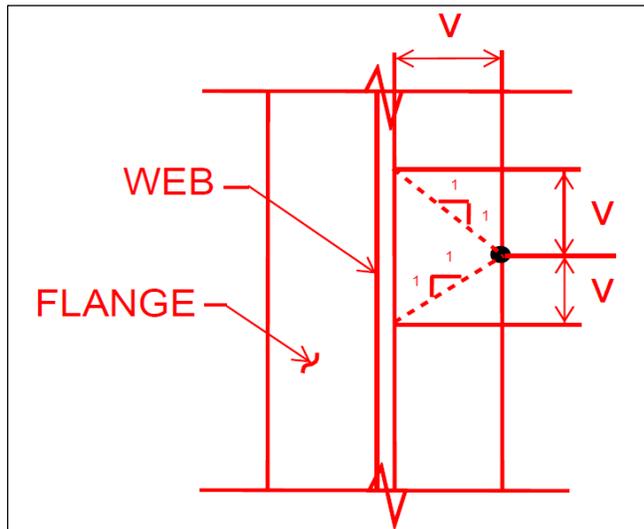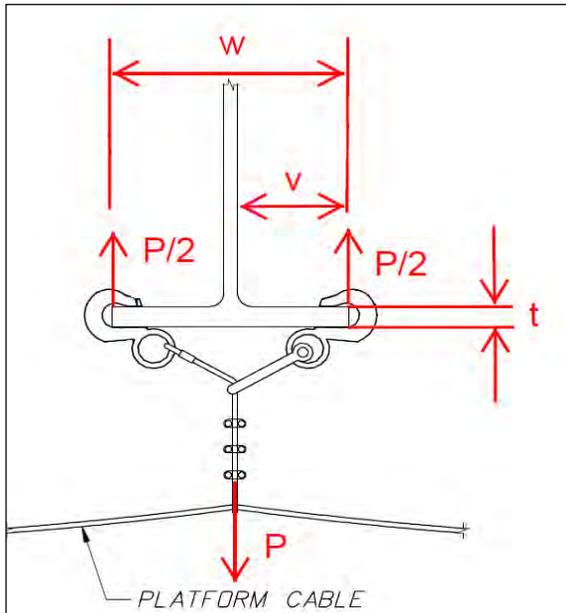

Appendix C

Scaffold Design



Subject: Abrasive Blasting Containment Plans			
Eleven Bridges on I-91, County of Windsor, Vermont			
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

1. Scaffold Configuration:

Length = 32 ft.
 Width = 28 in.
 Weight = 213 lb
 Assume Weight = 220 lb

2. Abrasive Cleaning Material:

Assume **0** inch of steel shot will cover the scaffold

Depth = 0 in.
 Density of the shot = 280 pcf
 Weight of the shot = 0.00 psf

3. Total Loads:

With full workers and no shot

Dead Load = 220.00 lb (see note below)
 Live Load ** = **800** lb (see note below)

NOTE: The scaffold cable carries the load from two scaffolds where the length of scaffold exceeds 32 ft.
 ** Assuming four 200 lb workers (average weight) all at one cable at adjoining ends of the scaffold.

Use 1/2 " dia. 6x19 IWRC, EIP, or better

Cable diameter = 1/2 in
 Cable weight = 0.46 plf
 Cable strength = 13.3 tons

NOTE: The cable carries the DL from 2 scaffolds + 10% for overlap

Spacing = 25 ft
 PickupSpacing = **25** ft
 d = 5% of PickupSpacing = 15 in.
 d = 15 in.
 Use d = **18** in.
 Tension at the center = 4.34 kips
 Tension at the support = 4.37 kips

FS of the cable = 6.08 >= 6.0 OK

Use Shackle Size = 5/8 in
 Working Load limit = 3.25 tons
 Working Load at supports = 2.19 tons
 Shackle Load Ratio = 1.49

Shackle Check = Ok



Subject: Abrasive Blasting Containment Plans			
Eleven Bridges on I-91, County of Windsor, Vermont			
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

4. Scaffold Support Hanger:

Hanger support load = 1020 lb
Use = 1100 lb

Use 3/8 " dia. 6x19 IWRC, EIP cables

Hanger diameter = 3/8 in
Hanger weight = 0.26 plf
Hanger strength = 7.55 tons

FS of the hanger = 13.73 >= 6.0 OK

Min. Chain working load = 7100 lb (min)
Chain Design Load = 1020 lb
Use = 1100 lb

Chain Hanger Stress Ratio = 6.45 >=1.0 OK

Use Shackle Size = 1/2 in
Working Load limit = 2.00 tons
Working Load at supports = 0.55 tons
Shackle Load Ratio = 3.64

Shackle Check = Ok

5. Optional Suspended Scaffold:

Hanger support load = 910 lb per two rods
Misc. rod loads = 100 lb
3/4" diameter metal rod, Fy = 36 ksi
Total weight on one rod = 505 lb
Area 3/4" Rod = 0.44 in²
fa = P/A = 1.14 ksi

Metal Rod Check = Ok



Subject: Abrasive Blasting Containment Plans			
Eleven Bridges on I-91, County of Windsor, Vermont			
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

1. Scaffold Configuration:

Length = 32 ft.
 Width = 28 in.
 Weight = 213 lb
 Assume Weight = 220 lb

2. Abrasive Cleaning Material:

Assume **1/4** inch of steel shot will cover the scaffold

Depth = 1/4 in.
 Density of the shot = 280 pcf
 Weight of the shot = 5.83 psf

3. Total Loads:

With full shot and no workers

Dead Load = 655.56 lb (see note below)
 Live Load = 0 lb (see note below)

NOTE: The scaffold cable carries the load from two scaffolds where the length of scaffold exceeds 32 ft.

Use 1/2 " dia. 6x19 IWRC, EIP, or better

Cable diameter = 1/2 in
 Cable weight = 0.46 plf
 Cable strength = 13.3 tons

NOTE: The cable carries the DL from 2 scaffolds + 10% for overlap

Spacing = 25 ft
 PickupSpacing = **20** ft
 d = 5% of PickupSpacing = 12 in.
 d = 12 in.
 Use d = **18** in.
 Tension at the center = 2.40 kips
 Tension at the support = 2.43 kips

FS of the cable = 10.96 >= 6.0 OK

Use Shackle Size = 5/8 in
 Working Load limit = 3.25 tons
 Working Load at supports = 1.21 tons
 Shackle Load Ratio = 2.68

Shackle Check = Ok



Subject: Abrasive Blasting Containment Plans			
Eleven Bridges on I-91, County of Windsor, Vermont			
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

4. Scaffold Support Hanger:

Hanger support load = 656 lb
Use = 700 lb

Use 3/8 " dia. 6x19 IWRC, EIP cables

Hanger diameter = 3/8 in
Hanger weight = 0.26 plf
Hanger strength = 7.55 tons

FS of the hanger = 21.57 >= 6.0 OK

Min. Chain working load = 7100 lb (min)
Chain Design Load = 656 lb
Use = 700 lb

Chain Hanger Stress Ratio = 10.14 >=1.0 OK

Use Shackle Size = 1/2 in
Working Load limit = 2.00 tons
Working Load at supports = 0.35 tons
Shackle Load Ratio = 5.71

Shackle Check = Ok

5. Optional Suspended Scaffold:

Hanger support load = 328 lb per two rods
Misc. rod loads = 100 lb
3/4" diameter metal rod, Fy = 36 ksi
Total weight on one rod = 214 lb
Area 3/4" Rod = 0.44 in²
fa = P/A = 0.48 ksi

Metal Rod Check = Ok

Appendix D

Miscellaneous Hardware

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

Cable Anchorage Plate Connection:

Design the cable anchor plate attachment. The cable needs only sufficient tension to reduce the sag and support the cable. The connection must be designed to resist the allowable working load of the cable with a factor of safety of 4 per OSHA.

The members used to construct the paint containment platform will be checked for compliance with OSHA requirements for scaffolding - 29 CFR, Part 1910 Standard Number 1910.28:

1910.28(a)(4): Scaffolds and their components shall be capable of supporting without failure at least four times the maximum intended load.

1910.28.(a)(22): Wire or fiber rope used for scaffold suspension shall be capable of supporting at least six times the intended load.

1. Material Properties:

Nom. Strength of 0.625" diam. 6 x 19 EIP IWRC cable =	_____	20.6 tons
RopeWeight _{cable} =	_____	0.72 plf
Allowable Strength of cable, T _{cable.allow} =	_____	6.87 kips
Chain link platform analysis, the cable load at the support is (Service Loads):		
P _{anchor.plate.design} = DL + LL _u =	_____	19.00 psf
Weight _{anchor.plate} =	_____	100.47 plf
T _{support.anchor.plate} =	_____	5.38 kips

The allowable load in the cable exceeds the service load at the anchor plate. Therefore, use the allowable load in the cable to design the anchor plate.

Structural Steel (A36 steel):	F _{y,A36} =	_____	36 ksi
	F _{u,A36} =	_____	58 ksi
Weld Metal (E70XX electrodes)	F _{u,weld} =	_____	70 ksi
	E =	_____	29000 ksi
	d = _____ 18 in	Lspan = _____	25 ft

2. Check the anchorage capacity:

3/4" diam. Anchor with a 6 5/8" embedment, F _{t,u} =	_____	10980 lbf
Allowable Tension for a 6 5/8" embedment, F _{t.allow} =	_____	2.75 kips
Number of anchors required for pure tension =	_____	2.50 (Use 4 anchors)
Ult. shear value for a 3/4" diam. Anchor F _{v,u} =	_____	20320 lbf
Allow. Shear (3/4" diam., 6 5/8" embedment) F _{v.allow} =	_____	5.08 kips
No. Anchors required for pure shear =	_____	1.85

From the chain link platform analysis, the longitudinal pickup point spacing is:
 Sag = atan [d / (0.5 * Longspan)] _____ 6.84 degrees

Anchor plate connection can accommodate 4 anchors. From the analysis, a minimum of 4 wedge anchors are required. Since the cable angle from the pier cap anchorage to the anchor plate may vary, check the deck anchorage for 0, 5, 10, 15 and 20 degrees.



Subject: Abrasive Blasting Containment Plans		
Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number:
Check by: PRS	Job No: 187-18-1	

No. of anchors assumed:	No. Anchors =	4
For the cable at a 0 degree angle:	$\emptyset =$	0 degrees
$f_{t,cable} = T_{cable.allow}(\sin\emptyset)$	$f_{t,cable} =$	0 kips
$f_{v,cable} = T_{cable.allow}(\cos\emptyset)$	$f_{v,cable} =$	6.87 kips
Combined Stress Ratio	Dem./Capacity CSR =	0.34 < 1.0 OK

No. of anchors assumed:	No. Anchors =	4
For the cable at a 5 degree angle:	$\emptyset =$	5 degrees
$f_{t,cable} = T_{cable.allow}(\sin\emptyset)$	$f_{t,cable} =$	0.60 kips
$f_{v,cable} = T_{cable.allow}(\cos\emptyset)$	$f_{v,cable} =$	6.84 kips
Combined Stress Ratio	Dem./Capacity CSR =	0.39 < 1.0 OK

No. of anchors assumed:	No. Anchors =	4
For the cable at a 10 degree angle:	$\emptyset =$	10 degrees
$f_{t,cable} = T_{cable.allow}(\sin\emptyset)$	$f_{t,cable} =$	1.19 kips
$f_{v,cable} = T_{cable.allow}(\cos\emptyset)$	$f_{v,cable} =$	6.76 kips
Combined Stress Ratio	Dem./Capacity CSR =	0.44 < 1.0 OK

No. of anchors assumed:	No. Anchors =	4
For the cable at a 15 degree angle:	$\emptyset =$	15 degrees
$f_{t,cable} = T_{cable.allow}(\sin\emptyset)$	$f_{t,cable} =$	1.78 kips
$f_{v,cable} = T_{cable.allow}(\cos\emptyset)$	$f_{v,cable} =$	6.63 kips
Combined Stress Ratio	Dem./Capacity CSR =	0.49 < 1.0 OK



No. of anchors assumed:	No. Anchors =	4
For the cable at a 20 degree angle:	$\emptyset =$	20 degrees
$f_{t,cable} = T_{cable.allow}(\sin\emptyset)$	$f_{t,cable} =$	2.35 kips
$f_{v,cable} = T_{cable.allow}(\cos\emptyset)$	$f_{v,cable} =$	6.45 kips
Combined Stress Ratio	Dem./Capacity CSR =	0.53 < 1.0 OK

3. Weld Design:

Design for a tension load: $T_{design} = T_{cable}$, $T_{design} =$ 41.2 kips
 For a 3/4" x 5" x 5" plate, min. weld or strength, $t_{weld} =$ 0.20 in.
 Minimum weld size = 3.14 in.
 Minimum weld size is 2/16"
 Per AASHTO Standard Specifications, Section 10.23.2.2, the minimum size weld for a 1" plate is 5/16" (0.3857 in.), therefore, specify the minimum weld size.

4. Determine the Minimum Connection Plate Size:

The bearing width of a 0.75 " shackle, $b =$ 0.88 in.
 Limit the allowable shear stress through the connection plate to bearing stress in pins to ASCE Manual of Steel Construction, ASD, 9th Ed., Part 5, Section D3:
 $F_p = 0.45 * F_{u,A36}$ 26.1 ksi
 The 1 1/4" diam. Hole is at 1 7/8" from the edge, therefore, the minimum edge dist. Is:
 $d_{edge,min} =$ 1.25 in.
 Shear thru plate, $f_{y,plate} =$ 6.24 ksi
 Limit the allowable bearing through the connection plate to bearing stress in pins to ASCE Manual of Steel Construction, ASD 9th Ed. Part 5, Section J8:
 $F_p = 0.90 * F_{u,A36} =$ 52.2 ksi
 Required Plate Thickness: $t_{plate} =$ 0.15 in.
 Specify a 3/4" plate

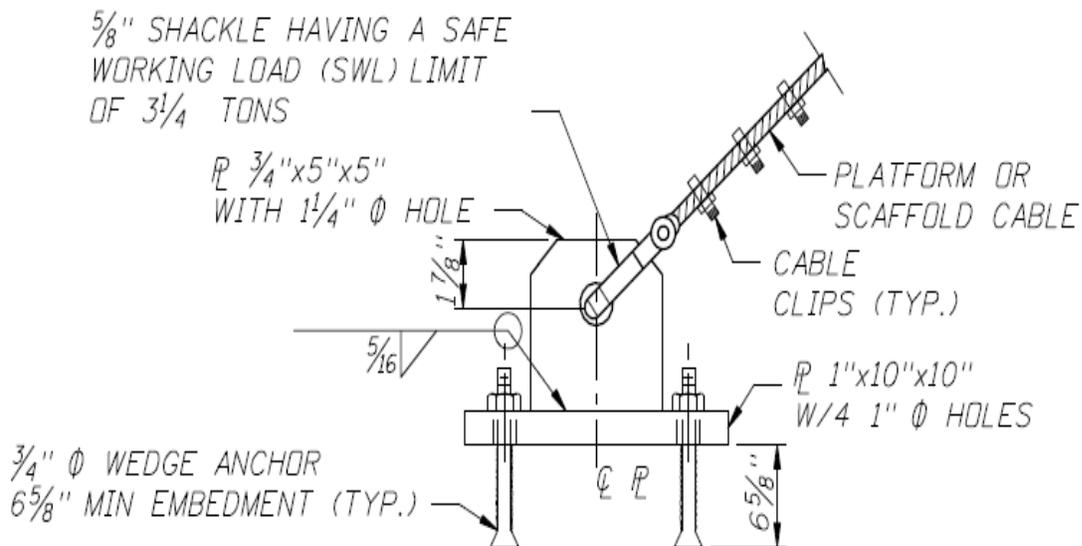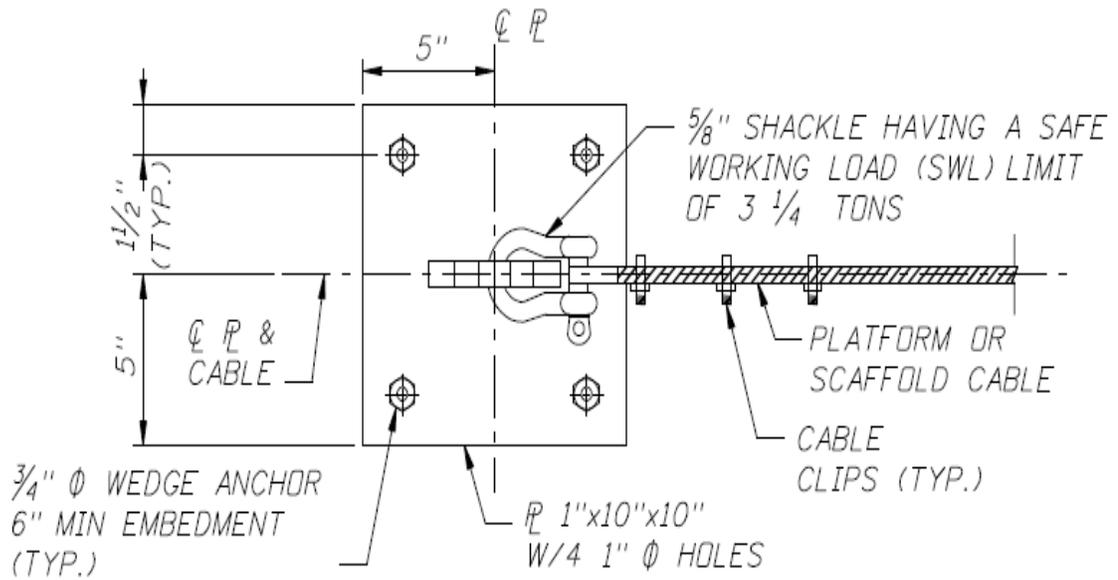


OPTIONAL ANCHOR PLATE ATTACHMENT


	Subject: Abrasive Blasting Containment Plans Eleven Bridges on I-91, County of Windsor, Vermont	
	Comp by: MAT Check by: PRS	Date: 02/08/16 Job No: 187-18-1

The following calculations are based on a worst-case-scenario, where 5/8" cables are tensioned.

Cable Attachment at Bearings:

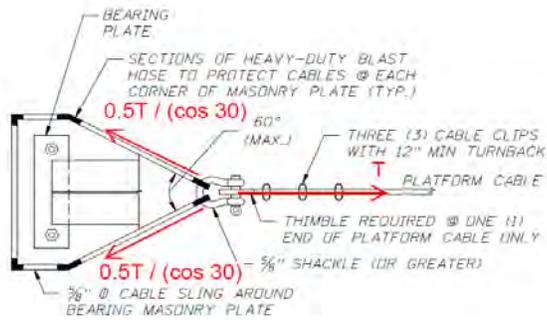


Mid Bay Cable Attachments:

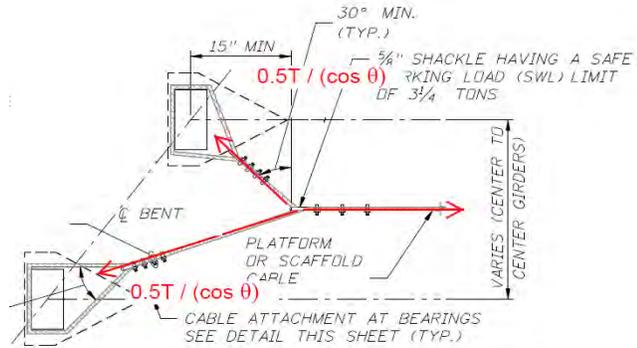

Max. Tension on 5/8" Platform Cable, T = 20.6 tons
 $0.5 T / (\cos (\text{max. angle}/2)) = T$
 Angle = 30.0 deg
Specify a Maximum Angle of = 30.0 deg

Max. Tension on 5/8" Platform Cable, T = 20.6 tons
 $T / \cos(\text{angle}) = 2T$ (2 cables)
 Angle = 30.0 deg
Specify a Maximum Angle of = 30.0 deg

Transverse Cable Attachment:

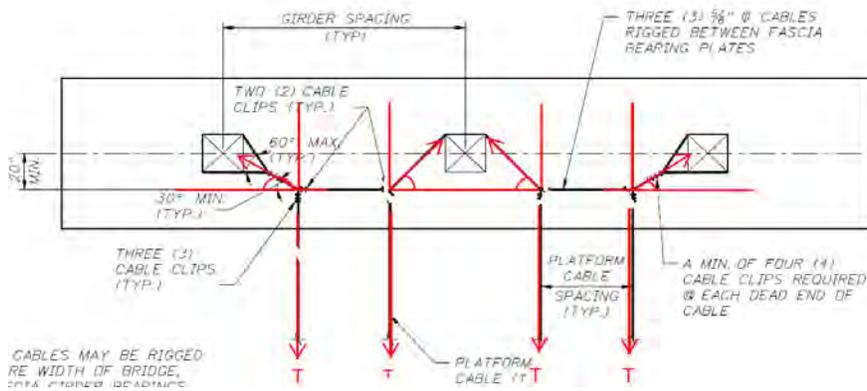


Max. Tension on 5/8" Platform Cable, T = 20.6 tons
 $T / \cos(\text{angle}) = 3T$ (3 cables)
 Angle = 19.5 deg
Specify a Maximum Angle of = 30.0 deg

Max. Tension on 5/8" Platform Cable, T = 20.6 tons
 $T / \cos(\text{angle}) = 2T$ (2 cables)
 Angle = 30.0 deg
Specify a Maximum Angle of = 30.0 deg

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number:	
Check by: PRS	Job No: 187-18-1		

Alternate Transverse Cable Attachment:

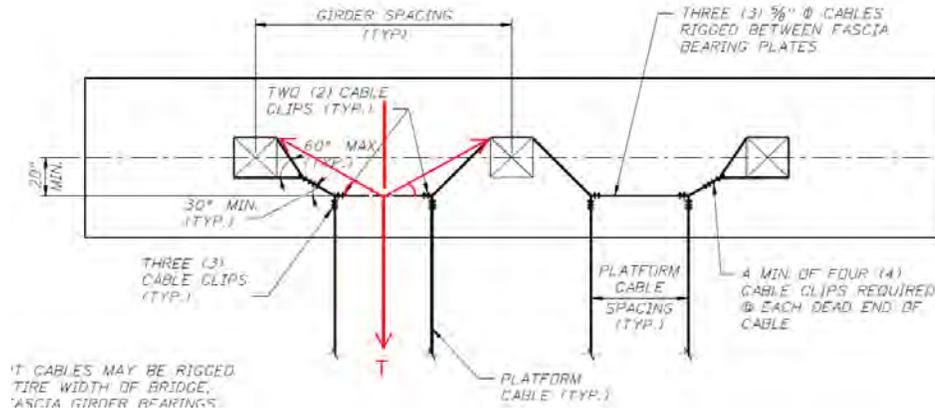


Max. Tension on 5/8" Platform Cable, T = 20.6 tons
 $0.5T / \cos(\text{angle}) = 3T$
 Angle = 9.6 deg
Specify a Maximum Angle of = 30.0 deg

Alternate Support Hanger:

1/2" Platform Support Cable:
 Max. Tension, T = 13.3 tons
 $0.5T / \sin(\text{angle}) = T$
 Angle = 30.0 deg
Specify a Minimum Angle of = 30.0 deg

(2) 1-Ton Rated Eye Hooks = 2 tons
 Max. Hanger Load (Ult.) = 7.48 tons
 Factor of Safety = 6
 Max. Hanger Load (Service) = 1.25 tons
Eye Hook Check: Ok

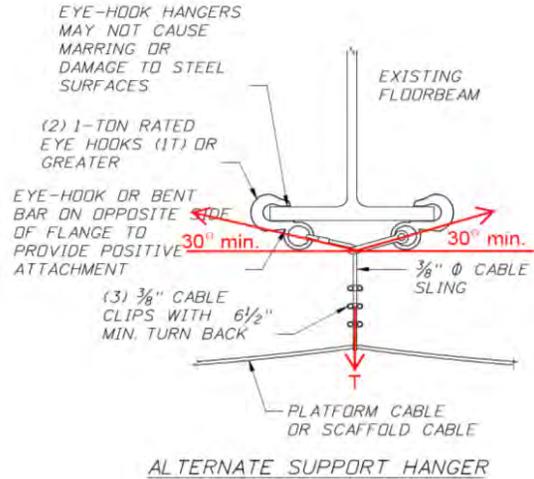

Intermediate Containment Support Analysis:


Use a TS 4x4x1/4 supported on the bridge beams bottom flanges for the intermediate pickup point supports.

TS 4 x 4 x 1/4:

DL _{TS} =	12.21	plf	I _{TS} =	7.8	in ⁴
A _{TS} =	3.37	in ²	T _{ts} =	0.233	in
B _{ts} =	4	in	b _{Tts} =	14.2	-
S _{TS} =	3.9	in ³	h _{Tts} =	14.2	-
h _{TS} =	4	in	F _{yHSS} =	46	KSI (ASTM A-500, Grade B)

Check Shear:

Tributary Cable Width =	5.25	ft
Max. Hanger Spacing =	25	ft
Dead Load =	3.00	psf
Live Load =	16.00	psf
Support Load on the TS 4 x 4 x 1/4 =	2493.75	lb
fv =	3.01	ksi
0.33*F _{yHSS} =	15.18	ksi
Capacity/Demand Ratio =	5.04	

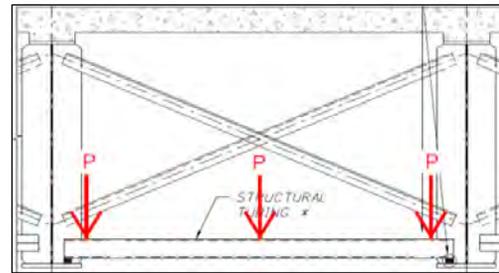

Conservative to use 3 loads P on tubing

TS Check for Shear: Ok

Bending Analysis:

Check the max. bending moment in the TS with the cable load centered between two girders.

Reference AISC Beam Equation 7

Max. Girder Spacing =	9.5	ft
M _{max} =	5.92	kip-ft (M = PL/4)
f _y = M _{max} /S _{TS} =	18.22	ksi
0.6*F _{yHSS} =	27.60	ksi
Capacity/Demand Ratio =	1.51	

TS Check for Bending: Ok

Check the max. bending moment in the TS with two cable loads centered between two girders.

Reference AISC 9th edition Beam Equation 41

M _{max} =	6.20	kip-ft
f _y = M _{max} /S _{TS} =	19.09	ksi
0.6*F _{yHSS} =	27.60	ksi
Capacity/Demand Ratio =	1.45	

TS Check for Bending: Ok

Intermediate Containment Support Analysis:


Use a TS 4x4x3/8 supported on the bridge beams bottom flanges for the intermediate pickup point supports.

TS 4 x 4 x 3/8:

DL _{TS} =	17.2 plf	I _{TS} =	10.3 in ⁴	(ASTM A-500, Grade B)
A _{TS} =	4.78 in ²	T _{ts} =	0.349 in	
B _{ts} =	4 in	b _{Tts} =	8.46 -	
S _{TS} =	5.13 in ³	h _{Tts} =	8.46 -	
h _{TS} =	4 in	F _{yHSS} =	46 KSI	

Check Shear:

Tributary Cable Width =	5.25 ft
Max. Hanger Spacing =	25 ft
Dead Load =	3.00 psf
Live Load =	16.00 psf
Support Load on the TS 4 x 4 x 3/8 =	2493.75 lbf
fv =	2.01 ksi
0.33*F _{yHSS} =	15.18 ksi
Capacity/Demand Ratio =	7.55

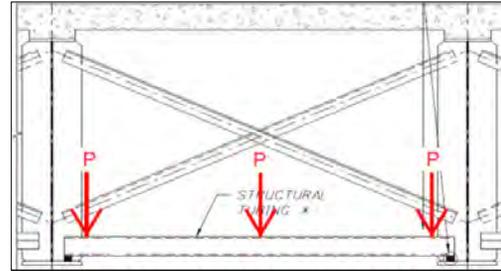

Conservative to use 3 loads P on tubing

TS Check for Shear: Ok

Bending Analysis:

Check the max. bending moment in the TS with the cable load centered between two girders.

Reference AISC Beam Equation 7

Max. Girder Spacing =	11 ft
M _{max} =	6.86 kip-ft (M = PL/4)
fy = M _{max} /S _{TS} =	16.04 ksi
0.6*F _{yHSS} =	27.60 ksi
Capacity/Demand Ratio =	1.72

TS Check for Bending: Ok

Check the max. bending moment in the TS with two cable loads centered between two girders.

Reference AISC 9th edition Beam Equation 41

Mmax =	7.95 kip-ft
fy = Mmax/STS =	18.60 ksi
0.6*F _{yHSS} =	27.60 ksi
Capacity/Demand Ratio =	1.48

TS Check for Bending: Ok

Support Hanger Analysis: (Type 1)

A. Design Loads:

Girder Spacing =	7.50 ft.	(Conservative)
Width of Platform =	6.00 ft.	
Number of Hangers =	2	(per Girder)
Tributary Area =	22.50 ft. ²	(per Hanger)
No. Workers per Platform =	2	
Weight of 1 Worker =	250 lb	
Assume Depth of Grit =	1/2 in	
Density of Steel Grit =	280 pcf	
Self Weight 4x2x1/8 Tubing =	4.75 plf	
Tributary Length of Tubing =	7.50 ft.	
Tarpaulin Weight =	0.13 psf	
Metal Decking Weight =	3.00 psf	(Conservative)
Tubing Load =	35.6 lb.	
18-oz Tarpaulin Load =	2.8 lb.	
Steel Grit Load =	262.5 lb.	
Metal Deck Load =	67.5 lb.	
Worker Load =	500.0 lb.	
Total Load per Hanger =	868.4 lb.	
Load per Hanger Hook =	434.2 lb.	


* Conservatively, use Load per Hanger Hook = 1000 lb. (2000 lb. Total)

* See RAM Element Analysis (bracket is designed for 1000 lb per hanger hook).

B. Bolt Analysis

Bolt Size =	5/8 in.
Vertical Reaction =	0.50 kips/bolt (RAM Elements Output)
Horizontal Reaction =	2.80 kips/bolt (RAM Elements Output)
Ultimate Shear, Ru =	2.84 kips/bolt
Two (2) Hooks =	5.69 kips/bolt
Shear Capacity, ΦR_n =	6.23 kips/bolt (AISC 14th Ed. Table 7-1)
Capacity/Demand Ratio =	1.10

Bolt Shear Check: OK

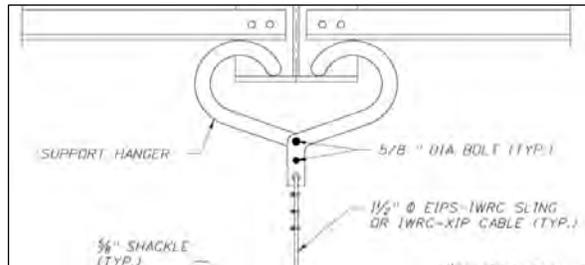



Subject: Abrasive Blasting Containment Plans		
Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number:
Check by: PRS	Job No: 187-18-1	

Total Reaction = 5.69 kips
 Slip Critical Shear Strength, ΦR_n = 6.44 kips/bolt (AISC 14th Ed. Table 7-3)
 Capacity/Demand Ratio = 1.13

Bolt Slip-Critical Check: OK

Available Bearing Strength at Bolt Holes = 51.10 kips/in (AISC 14th Ed. Table 7-4)
 Plate Thickness = 0.500 in.
 Total Reaction = 5.69 kips
 Bearing Strength = 25.55 kips/bolt
 Capacity/Demand Ratio = 4.49

Bolt Bearing Strength Check: OK

Structural Tubing Analysis:

Tributary Length of Tubing = 7.50 ft.
 Tubing Load = 35.6 lb.
 18-oz Tarpaulin Load = 2.8 lb.
 Steel Grit Load = 262.5 lb.
 Metal Deck Load = 67.5 lb.
 Worker Load = 500.0 lb.

Load on Tubing, P = 868.4 lb.
 Max. Moment on Tubing, Mmax = 19.54 kip-in (Conservative to use PL/4)
 HSS 4x2x1/8, Sx = 1.32 in³
 Yield Strength, Fy = 46 ksi
 Bending Stress, fb = 14.80 ksi
 Allowable Bending Stress, Fb = 30.36 ksi
 Capacity/Demand Ratio = 2.05

Bending Stress Check: OK

Metal Decking Analysis (From Table- Single Span, 20-Gauge):

Span Length = 6.00 ft. (Conservative)
 Span Condition = Single Span
 Uniform Dead Load = 16.38 psf
 Design Live Load = 50 psf (Minimum Construction Load)

Total Uniform Design Load = 66.38 psf
 Allowable Uniform Load = 69.00 psf (6 ft. spacing is conservative)
 Capacity/Demand Ratio = 1.04

Metal Decking Check: OK



Units system: English

Geometry data

GLOSSARY

Cb22, Cb33	: Moment gradient coefficients
Cm22, Cm33	: Coefficients applied to bending term in interaction formula
d0	: Tapered member section depth at J end of member
DJX	: Rigid end offset distance measured from J node in axis X
DJY	: Rigid end offset distance measured from J node in axis Y
DJZ	: Rigid end offset distance measured from J node in axis Z
DKX	: Rigid end offset distance measured from K node in axis X
DKY	: Rigid end offset distance measured from K node in axis Y
DKZ	: Rigid end offset distance measured from K node in axis Z
dL	: Tapered member section depth at K end of member
Ig factor	: Inertia reduction factor (Effective Inertia/Gross Inertia) for reinforced concrete members
K22	: Effective length factor about axis 2
K33	: Effective length factor about axis 3
L22	: Member length for calculation of axial capacity
L33	: Member length for calculation of axial capacity
LB pos	: Lateral unbraced length of the compression flange in the positive side of local axis 2
LB neg	: Lateral unbraced length of the compression flange in the negative side of local axis 2
RX	: Rotation about X
RY	: Rotation about Y
RZ	: Rotation about Z
TO	: 1 = Tension only member 0 = Normal member
TX	: Translation in X
TY	: Translation in Y
TZ	: Translation in Z

Nodes



Node	X [ft]	Y [ft]	Z [ft]	Rigid Floor
1	0.00	0.00	0.00	0
2	0.00	0.125	0.00	0
3	0.00	0.2917	0.00	0
4	0.00	0.4167	0.00	0
5	-0.375	0.60	0.00	0
6	-0.7583	0.75	0.00	0
7	-0.9167	0.8667	0.00	0
8	-0.9667	1.0833	0.00	0
9	-0.95	1.25	0.00	0
10	-0.8083	1.4167	0.00	0
11	-0.5833	1.50	0.00	0
12	-0.35	1.4167	0.00	0
13	-0.2333	1.2917	0.00	0
14	-0.2333	1.1667	0.00	0

Restraints

Node	TX	TY	TZ	RX	RY	RZ
3	1	0	1	0	1	0
4	1	0	1	0	0	0
14	0	1	0	0	0	0

Members

Member	NJ	NK	Description	Section	Material	d0 [in]	dL [in]	Ig factor
1	1	2		PL 1/2x2	A36	0.00	0.00	0.00
2	2	3		PL 1/2x2	A36	0.00	0.00	0.00
3	3	4		PL 1/2x2	A36	0.00	0.00	0.00
4	4	5		PL 1/2x2	A36	0.00	0.00	0.00
5	5	6		PL 1/2x2	A36	0.00	0.00	0.00
6	6	7		PL 1/2x2	A36	0.00	0.00	0.00
7	7	8		PL 1/2x2	A36	0.00	0.00	0.00
8	8	9		PL 1/2x2	A36	0.00	0.00	0.00
9	9	10		PL 1/2x2	A36	0.00	0.00	0.00
10	10	11		PL 1/2x2	A36	0.00	0.00	0.00
11	11	12		PL 1/2x2	A36	0.00	0.00	0.00
12	12	13		PL 1/2x2	A36	0.00	0.00	0.00
13	13	14		PL 1/2x2	A36	0.00	0.00	0.00

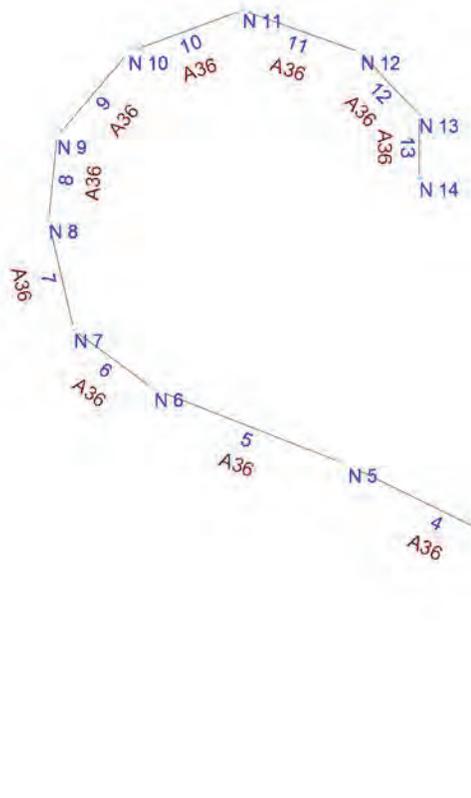


Units system: English

Section information

Section name: PL 1/2x2 (US)

Dimensions



a	=	2.000	[in]	Height
b	=	0.500	[in]	Width

Properties

Ag	:	1.000	[in ²]	Gross area of the section.
I 33	:	0.333	[in ⁴]	Moment of inertia about local axis 3.
I 22	:	0.021	[in ⁴]	Moment of inertia about local axis 2.
I 23	:	0.000	[in ⁴]	Product of inertia.
Ang 3' to 3	:	0.000	--	Angle to the principal axis. (°)
I 33'	:	0.333	[in ⁴]	Moment of inertia about principal axis 3.
I 22'	:	0.021	[in ⁴]	Moment of inertia about principal axis 2.
Dist. to cg 3	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 3 direction.
Dist. to cg 2	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 2 direction.
J	:	0.070	[in ⁴]	Saint-Venant torsion constant.
Xsc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 3.
Ysc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 2.
Cw	:	0.000	[in ⁶]	Section warping constant.
ro	:	0.595	[in]	Polar radius of gyration.
J 33'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 3.
J 22'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 2.
S 33 top	:	0.333	[in ³]	Top elastic section modulus about local axis 3.
S 33 bot	:	0.333	[in ³]	Bottom elastic section modulus about local axis 3.
S 22 top	:	0.083	[in ³]	Top elastic section modulus about local axis 2.
S 22 bot	:	0.083	[in ³]	Bottom elastic section modulus about local axis 2.
S 33' top	:	0.333	[in ³]	Top elastic section modulus about principal axis 3.
S 33' bot	:	0.333	[in ³]	Bottom elastic section modulus about principal axis 3.
S 22' top	:	0.083	[in ³]	Top elastic section modulus about principal axis 2.
S 22' bot	:	0.083	[in ³]	Bottom elastic section modulus about principal axis 2.
Z 33	:	0.500	[in ³]	Plastic section modulus about local axis 3.
Z 22	:	0.125	[in ³]	Plastic section modulus about local axis 2.
Z 33'	:	0.500	[in ³]	Plastic section modulus about principal axis 3.
Z 22'	:	0.125	[in ³]	Plastic section modulus about principal axis 2.
Max 3	:	0.250	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 3.
Min 3	:	-0.250	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 3.
Max 2	:	1.000	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 2.
Min 2	:	-1.000	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 2.
Aw3	:	1.000	[in ²]	Flange area for shear.
Aw2	:	1.000	[in ²]	Web area for shear.
C	:	0.595	[in ³]	Torsional constant.
Qmod2'	:	2.49E+05	[in ³]	Shear modulus for principal axis 2.
Qmod3'	:	2.49E+05	[in ³]	Shear modulus for principal axis 3.



Units system: English

Load data

GLOSSARY

Comb : Indicates if load condition is a load combination

Load conditions

Condition	Description	Comb.	Category
DL	Dead Load	No	DL
LC1	1.5DL	Yes	

Load on nodes

Condition	Node	FX [Kip]	FY [Kip]	FZ [Kip]	MX [Kip*ft]	MY [Kip*ft]	MZ [Kip*ft]
DL	2	0.00	-1.00	0.00	0.00	0.00	0.00

Self weight multipliers for load conditions

Condition	Description	Self weight multiplier			
		Comb.	MultX	MultY	MultZ
DL	Dead Load	No	0.00	-1.00	0.00
LC1	1.5DL	Yes	0.00	0.00	0.00

Earthquake (Dynamic analysis only)



Condition	a/g	Ang. [Deg]	Damp. [%]
DL	0.00	0.00	0.00
LC1	0.00	0.00	0.00

Units system: English

Load condition: DL=Dead Load

Loads

 Concentrated - Nodes

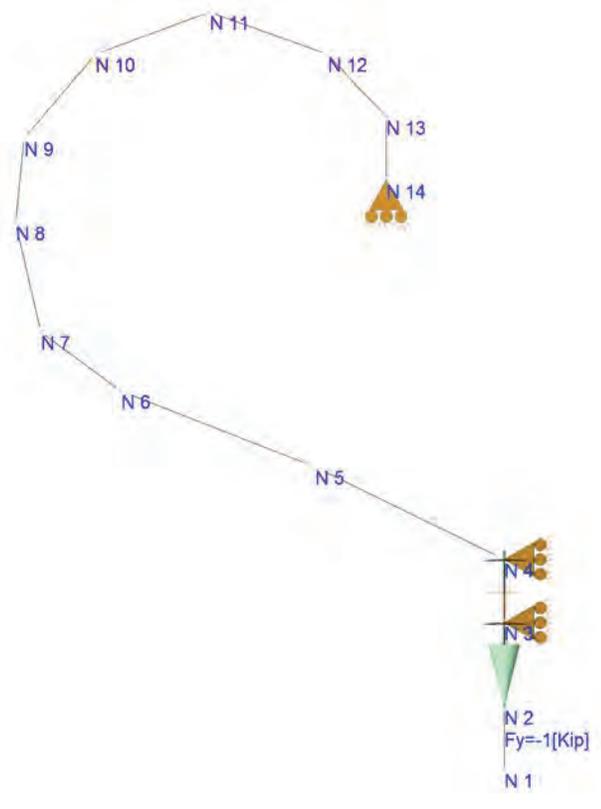


Units system: English

Analysis result

Translations

Node	Translations [in]			Rotations [Rad]		
	TX	TY	TZ	RX	RY	RZ
Condition LC1=1.5DL						
1	-0.00064	-0.13718	0.00000	0.00000	0.00000	-0.00018
2	-0.00036	-0.13718	0.00000	0.00000	0.00000	-0.00018
3	0.00000	-0.13707	0.00000	0.00000	0.00000	-0.00018
4	0.00000	-0.13699	0.00000	0.00000	0.00000	-0.00051
5	0.00241	-0.13181	0.00000	0.00000	0.00000	-0.00091
6	0.00197	-0.13266	0.00000	0.00000	0.00000	0.00218
7	-0.00275	-0.13896	0.00000	0.00000	0.00000	0.00486
8	-0.01987	-0.14277	0.00000	0.00000	0.00000	0.00840
9	-0.03945	-0.14071	0.00000	0.00000	0.00000	0.01115
10	-0.06519	-0.11869	0.00000	0.00000	0.00000	0.01435
11	-0.08100	-0.07586	0.00000	0.00000	0.00000	0.01687
12	-0.06325	-0.02600	0.00000	0.00000	0.00000	0.01821
13	-0.03559	-0.00008	0.00000	0.00000	0.00000	0.01845
14	-0.00791	0.00000	0.00000	0.00000	0.00000	0.01845


Reactions



Direction of positive forces and moments

Node	Forces [Kip]			Moments [Kip*ft]		
	FX	FY	FZ	MX	MY	MZ
Condition LC1=1.5DL						
3	2.77620	0.00000	0.00000	0.00000	0.00000	0.00000
4	-2.77578	0.00000	0.00000	0.00000	0.00000	0.00000
14	0.00000	1.51417	0.00000	0.00000	0.00000	0.00000
SUM	0.00042	1.51417	0.00000	0.00000	0.00000	0.00000

Points of interest in members

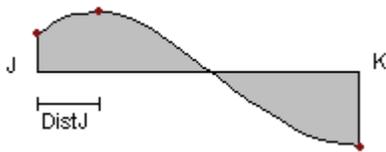

Considered points

Resisted by 2 bolts.

CONDITION : LC1=1.5DL

Station	Dist to J [ft]	Axial [Kip]	Plane 1-2			Plane 1-3	
			Shear V2 [Kip]	M33 [Kip*ft]	Shear V3 [Kip]	M22 [Kip*ft]	Torsion [Kip*ft]
MEMBER 1							
0%	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100%	0.125	0.000	0.000	0.000	0.000	0.000	0.000
MEMBER 2							
0%	0.000	1.500	0.000	0.000	0.000	0.000	0.000
100%	0.167	1.501	0.000	0.000	0.000	0.000	0.000
MEMBER 3							
0%	0.000	1.501	-2.776	0.000	0.000	0.000	0.000
100%	0.125	1.502	-2.776	-0.347	0.000	0.000	0.000
MEMBER 4							
0%	0.000	0.659	-1.350	0.347	0.000	0.000	0.000
100%	0.417	0.660	-1.351	-0.216	0.000	0.000	0.000
MEMBER 5							
0%	0.000	0.548	-1.401	-0.216	0.000	0.000	0.000
100%	0.412	0.549	-1.403	-0.793	0.000	0.000	0.000
MEMBER 6							
0%	0.000	0.893	-1.213	-0.793	0.000	0.000	0.000
100%	0.197	0.894	-1.214	-1.032	0.000	0.000	0.000
MEMBER 7							
0%	0.000	1.468	-0.339	-1.032	0.000	0.000	0.000
100%	0.222	1.469	-0.339	-1.110	0.000	0.000	0.000
MEMBER 8							
0%	0.000	1.501	-0.150	1.110	0.000	0.000	0.000
100%	0.167	1.501	-0.150	1.087	0.000	0.000	0.000
MEMBER 9							
0%	0.000	1.150	-0.978	1.087	0.000	0.000	0.000
100%	0.219	1.150	-0.978	0.877	0.000	0.000	0.000
MEMBER 10							
0%	0.000	0.524	-1.416	0.877	0.000	0.000	0.000
100%	0.240	0.525	-1.418	0.539	0.000	0.000	0.000
MEMBER 11							
0%	0.000	-0.508	-1.424	0.539	0.000	0.000	0.000
100%	0.248	-0.509	-1.425	0.184	0.000	0.000	0.000
MEMBER 12							
0%	0.000	-1.106	-1.032	0.184	0.000	0.000	0.000
100%	0.171	-1.106	-1.033	0.003	0.000	0.000	0.000
MEMBER 13							
0%	0.000	-1.514	0.000	0.003	0.000	0.000	0.000
100%	0.125	-1.514	0.000	0.000	0.000	0.000	0.000



Units system: English

Steel Code Check

Report: Summary - Group by section

Load conditions to be included in design :
LC1=1.5DL

Description	Section	Member	Ctrl Eq.	Ratio	Status	Reference
	<i>PL 1/2x2</i>	8	LC1 at 0.00%	0.91	OK	Eq. H1-1b

Units system: English

Steel Code Check

Report: Concise

Members: Hot-rolled


Design code: AISC 360-2010 LRFD

Member : 8
Design status : OK

Section information

Section name: PL 1/2x2 (US)

Dimensions



a = 2.000 [in] Height
b = 0.500 [in] Width

Properties

Section properties	Unit	Major axis	Minor axis
Gross area of the section. (Ag)	[in ²]	1.000	
Moment of Inertia (local axes) (I)	[in ⁴]	0.333	0.021
Moment of Inertia (principal axes) (I')	[in ⁴]	0.333	0.021
Bending constant for moments (principal axis) (J')	[in]	0.000	0.000
Radius of gyration (local axes) (r)	[in]	0.577	0.144
Radius of gyration (principal axes) (r')	[in]	0.577	0.144
Saint-Venant torsion constant. (J)	[in ⁴]	0.070	
Section warping constant. (Cw)	[in ⁶]	0.000	
Distance from centroid to shear center (principal axis) (x _o ,y _o)	[in]	0.000	0.000
Top elastic section modulus of the section (local axis) (S _{sup})	[in ³]	0.333	0.083
Bottom elastic section modulus of the section (local axis) (S _{inf})	[in ³]	0.333	0.083
Top elastic section modulus of the section (principal axis) (S' _{sup})	[in ³]	0.333	0.083
Bottom elastic section modulus of the section (principal axis) (S' _{inf})	[in ³]	0.333	0.083
Plastic section modulus (local axis) (Z)	[in ³]	0.500	0.125
Plastic section modulus (principal axis) (Z')	[in ³]	0.500	0.125
Polar radius of gyration. (r _o)	[in]	0.595	
Area for shear (A _w)	[in ²]	1.000	1.000
Torsional constant. (C)	[in ³]	0.595	

Material : A36

Properties	Unit	Value
Yield stress (Fy):	[Kip/in ²]	36.00
Tensile strength (Fu):	[Kip/in ²]	58.00
Elasticity Modulus (E):	[Kip/in ²]	29000.00
Shear modulus for steel (G):	[Kip/in ²]	11507.94

DESIGN CRITERIA

Description	Unit	Value
Length for tension slenderness ratio (L)	[ft]	0.17

Distance between member lateral bracing points

Length (Lb) [ft]	
Top	Bottom
4.00	4.00

Laterally unbraced length

Major axis(L33)	Length [ft]		Torsional axis(Lt)	Major axis(K33)	Effective length factor		Torsional axis(Kt)
	Minor axis(L22)				Minor axis(K22)		
0.17	0.17	0.17	0.17	1.0	1.0	1.0	1.0

Additional assumptions

Continuous lateral torsional restraint	No
Tension field action	No
Continuous flexural torsional restraint	No
Effective length factor value type	None
Major axis frame type	Sway
Minor axis frame type	Sway

DESIGN CHECKS

AXIAL TENSION DESIGN ✓

Axial tension

Ratio	:	0.05	Reference	:	Eq. D2-1
Capacity	:	32.40 [Kip]	Ctrl Eq.	:	LC1 at 100.00%
Demand	:	1.50 [Kip]			

Intermediate results	Unit	Value	Reference
Factored axial tension capacity(ϕP_n)	[Kip]	32.40	Eq. D2-1

AXIAL COMPRESSION DESIGN ✓

Compression in the major axis 33

Ratio	:	0.00	Reference	:	Sec. E1
Capacity	:	32.38 [Kip]	Ctrl Eq.	:	LC1 at 0.00%
Demand	:	0.00 [Kip]			

Intermediate results	Unit	Value	Reference
<u>Section classification</u>			
Factored flexural buckling strength(ϕP_{n33})	[Kip]	32.38	Sec. E1

Compression in the minor axis 22

Ratio	:	0.00		
Capacity	:	32.07 [Kip]	Reference	: Sec. E1
Demand	:	0.00 [Kip]	Ctrl Eq.	: LC1 at 0.00%

Intermediate results	Unit	Value	Reference
<u>Section classification</u>			
Factored flexural buckling strength(ϕP_{n22})	[Kip]	32.07	Sec. E1

FLEXURAL DESIGN

Bending about major axis, M33

Ratio	:	0.89		
Capacity	:	1.25 [Kip*ft]	Reference	: Sec. F1
Demand	:	1.11 [Kip*ft]	Ctrl Eq.	: LC1 at 0.00%

Intermediate results	Unit	Value	Reference
<u>Section classification</u>			
Factored lateral-torsional buckling strength(ϕM_n)	[Kip*ft]	1.25	Sec. F1

Bending about minor axis, M22

Ratio	:	0.00		
Capacity	:	0.34 [Kip*ft]	Reference	: Sec. F1
Demand	:	0.00 [Kip*ft]	Ctrl Eq.	: LC1 at 0.00%

Intermediate results	Unit	Value	Reference
<u>Section classification</u>			
Factored yielding strength(ϕM_n)	[Kip*ft]	0.34	Sec. F1

DESIGN FOR SHEAR

Shear in major axis 33

Ratio	:	0.00		
Capacity	:	19.44 [Kip]		
Demand	:	0.00 [Kip]	Ctrl Eq.	: LC1 at 0.00%

Intermediate results	Unit	Value	Reference
Factored shear capacity(ϕV_n)	[Kip]	19.44	

Shear in minor axis 22

Ratio : 0.01
 Capacity : 19.44 [Kip]
 Demand : -0.15 [Kip]

Ctrl Eq. : LC1 at 100.00%

Intermediate results	Unit	Value	Reference
Factored shear capacity(ϕV_n)	[Kip]	19.44	

TORSION DESIGN ✔

Torsion

Ratio : 0.00
 Capacity : 0.23 [Kip*ft]
 Demand : 0.00 [Kip*ft]

Ctrl Eq. : LC1 at 0.00%

Intermediate results	Unit	Value	Reference
Factored torsion capacity(ϕT_n)	[Kip*ft]	0.23	

COMBINED ACTIONS DESIGN ✔

Combined flexure and axial compression

Ratio : 0.89
 Ctrl Eq. : LC1 at 0.00%

Reference : Eq. H1-1b

Intermediate results	Unit	Value	Reference
Interaction of flexure and axial force	--	0.89	Eq. H1-1b

Combined flexure and axial tension

Ratio : 0.91
 Ctrl Eq. : LC1 at 0.00%

Reference : Eq. H1-1b

Intermediate results	Unit	Value	Reference

Combined flexure and axial compression about local axis

Ratio : N/A
 Ctrl Eq. : --

Reference :

Combined flexure and axial tension about local axis

Ratio : N/A
 Ctrl Eq. : --

Reference :

Combined torsion, flexure, shear and axial compression

.....
Ratio : N/A
Ctrl Eq. : -- Reference :
.....




Combined torsion, flexure, shear and axial tension

.....
Ratio : N/A
Ctrl Eq. : -- Reference :
.....

Units system: English

Load condition: DL=Dead Load

Member stresses
[Kip/in²]

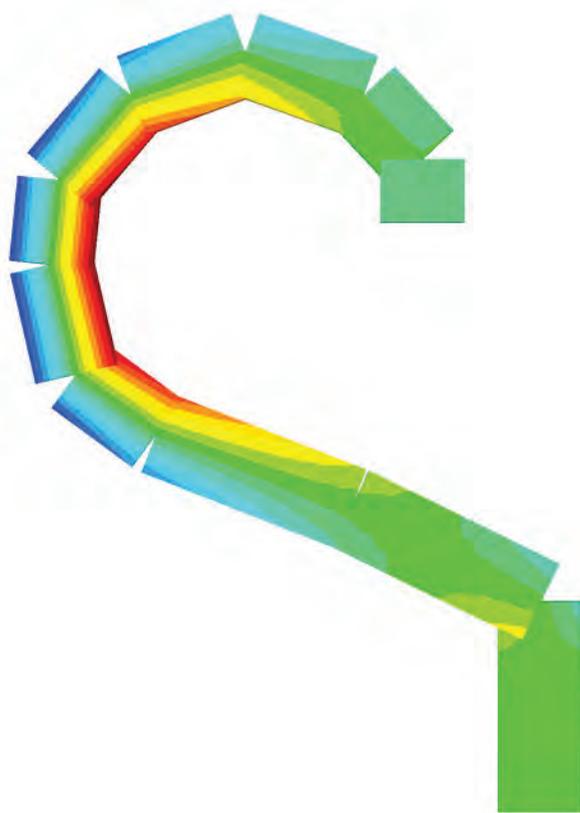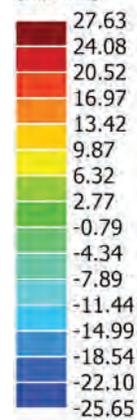

Support Hanger Analysis: (Type 2)

A. Design Loads:

Girder Spacing =	7.50 ft.	(Conservative)
Width of Platform =	6.00 ft.	
Number of Hangers =	2	(per Girder)
Tributary Area =	22.50 ft. ²	(per Hanger)
No. Workers per Platform =	2	
Weight of 1 Worker =	250 lb	
Assume Depth of Grit =	1/2 in	
Density of Steel Grit =	280 pcf	
Self Weight 4x2x1/8 Tubing =	4.75 plf	
Tributary Length of Tubing =	7.50 ft.	
Tarpaulin Weight =	0.13 psf	
Metal Decking Weight =	3.00 psf	(Conservative)
Tubing Load =	35.6 lb.	
18-oz Tarpaulin Load =	2.8 lb.	
Steel Grit Load =	262.5 lb.	
Metal Deck Load =	67.5 lb.	
Worker Load =	500.0 lb.	
Total Load per Hanger =	868.4 lb.	
Load per Hanger Hook =	434.2 lb.	


* Conservatively, use Load per Hanger Hook = 1000 lb. (2000 lb. Total)

* See RAM Element Analysis (bracket is designed for 1000 lb per hanger hook, resulting in 89% demand/capacity ratio)

B. Bolt Analysis

Bolt Size =	3/4 in.
Vertical Reaction =	3.86 kips/bolt (RAM Elements Output)
Horizontal Reaction =	1.75 kips/bolt (RAM Elements Output)
Ultimate Shear, R _u =	4.24 kips/bolt
Number of Bolts =	2
Two (2) Hooks =	8.48 kips
Shear Capacity, ΦR _n =	12.4 kips/bolt (AISC 14th Ed. Table 7-1)
Capacity/Demand Ratio =	1.46

Bolt Shear Check: OK

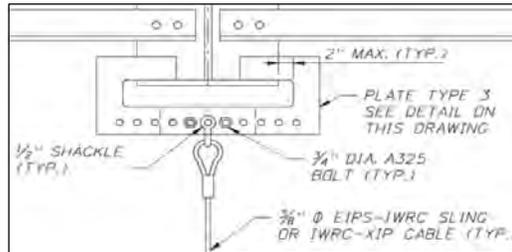

Subject: Abrasive Blasting Containment Plans Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____
Check by: PRS	Job No: 187-18-1	

Total Reaction = 8.48 kips
 Slip Critical Shear Strength, ΦR_n = 9.49 kips/bolt (AISC 14th Ed. Table 7-3)
 Capacity/Demand Ratio = 1.12

Bolt Slip-Critical Check: OK

Available Bearing Strength at Bolt Holes = 62.00 kips/in (AISC 14th Ed. Table 7-4)
 Plate Thickness = 0.375 in.
 Total Reaction = 8.48 kips
 Bearing Strength = 23.25 kips/bolt
 Capacity/Demand Ratio = 2.74

Bolt Bearing Strength Check: OK

Structural Tubing Analysis:

Tributary Length of Tubing = 7.50 ft.
 Tubing Load = 35.6 lb.
 18-oz Tarpaulin Load = 2.8 lb.
 Steel Grit Load = 262.5 lb.
 Metal Deck Load = 67.5 lb.
 Worker Load = 500.0 lb.

Load on Tubing, P = 868.4 lb.
 Max. Moment on Tubing, M_{max} = 19.54 kip-in (Conservative to use PL/4)
 HSS 4x2x1/8, S_x = 1.32 in³
 Yield Strength, F_y = 46 ksi
 Bending Stress, f_b = 14.80 ksi
 Allowable Bending Stress, F_b = 30.36 ksi
 Capacity/Demand Ratio = 2.05


Bending Stress Check: OK

Metal Decking Analysis (From Table- Single Span, 20-Gauge):

Span Length = 6.00 ft. (Conservative)
 Span Condition = Single Span
 Uniform Dead Load = 16.38 psf
 Design Live Load = 50 psf (Minimum Construction Load)

Total Uniform Design Load = 66.38 psf
 Allowable Uniform Load = 69 psf (6 ft. spacing is conservative)
 Capacity/Demand Ratio = 1.04

Metal Decking Check: OK

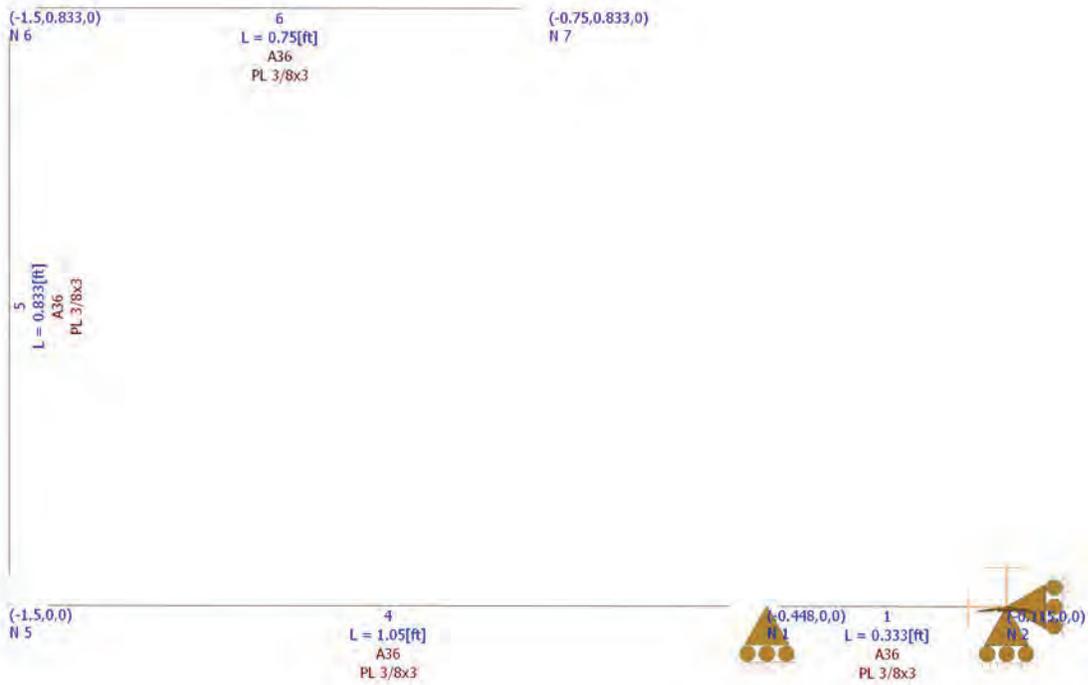



Units system: English

Geometry data

GLOSSARY

Cb22, Cb33	: Moment gradient coefficients
Cm22, Cm33	: Coefficients applied to bending term in interaction formula
d0	: Tapered member section depth at J end of member
DJX	: Rigid end offset distance measured from J node in axis X
DJY	: Rigid end offset distance measured from J node in axis Y
DJZ	: Rigid end offset distance measured from J node in axis Z
DKX	: Rigid end offset distance measured from K node in axis X
DKY	: Rigid end offset distance measured from K node in axis Y
DKZ	: Rigid end offset distance measured from K node in axis Z
dL	: Tapered member section depth at K end of member
Ig factor	: Inertia reduction factor (Effective Inertia/Gross Inertia) for reinforced concrete members
K22	: Effective length factor about axis 2
K33	: Effective length factor about axis 3
L22	: Member length for calculation of axial capacity
L33	: Member length for calculation of axial capacity
LB pos	: Lateral unbraced length of the compression flange in the positive side of local axis 2
LB neg	: Lateral unbraced length of the compression flange in the negative side of local axis 2
RX	: Rotation about X
RY	: Rotation about Y
RZ	: Rotation about Z
TO	: 1 = Tension only member 0 = Normal member
TX	: Translation in X
TY	: Translation in Y
TZ	: Translation in Z

Nodes

Node	X [ft]	Y [ft]	Z [ft]	Rigid Floor
1	-0.448	0.00	0.00	0
2	-0.115	0.00	0.00	0
5	-1.50	0.00	0.00	0
6	-1.50	0.833	0.00	0
7	-0.75	0.833	0.00	0

Restraints

Node	TX	TY	TZ	RX	RY	RZ
1	0	1	0	0	0	0
2	1	1	1	1	1	0

Members


Member	NJ	NK	Description	Section	Material	d0 [in]	dL [in]	Ig factor
1	1	2		PL 3/8x3	A36	0.00	0.00	0.00
4	1	5		PL 3/8x3	A36	0.00	0.00	0.00
5	5	6		PL 3/8x3	A36	0.00	0.00	0.00
6	6	7		PL 3/8x3	A36	0.00	0.00	0.00

Units system: English

Section information

Section name: PL 3/8x3 (US)

Dimensions



a	=	3.000	[in]	Height
b	=	0.375	[in]	Width

Properties



Ag	:	1.125	[in ²]	Gross area of the section.
I 33	:	0.844	[in ⁴]	Moment of inertia about local axis 3.
I 22	:	0.013	[in ⁴]	Moment of inertia about local axis 2.
I 23	:	0.000	[in ⁴]	Product of inertia.
Ang 3' to 3	:	0.000	--	Angle to the principal axis. (°)
I 33'	:	0.844	[in ⁴]	Moment of inertia about principal axis 3.
I 22'	:	0.013	[in ⁴]	Moment of inertia about principal axis 2.
Dist. to cg 3	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 3 direction.
Dist. to cg 2	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 2 direction.
J	:	0.049	[in ⁴]	Saint-Venant torsion constant.
Xsc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 3.
Ysc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 2.
Cw	:	0.000	[in ⁶]	Section warping constant.
ro	:	0.873	[in]	Polar radius of gyration.
J 33'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 3.
J 22'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 2.
S 33 top	:	0.563	[in ³]	Top elastic section modulus about local axis 3.
S 33 bot	:	0.563	[in ³]	Bottom elastic section modulus about local axis 3.
S 22 top	:	0.070	[in ³]	Top elastic section modulus about local axis 2.
S 22 bot	:	0.070	[in ³]	Bottom elastic section modulus about local axis 2.
S 33' top	:	0.563	[in ³]	Top elastic section modulus about principal axis 3.
S 33' bot	:	0.563	[in ³]	Bottom elastic section modulus about principal axis 3.
S 22' top	:	0.070	[in ³]	Top elastic section modulus about principal axis 2.
S 22' bot	:	0.070	[in ³]	Bottom elastic section modulus about principal axis 2.
Z 33	:	0.844	[in ³]	Plastic section modulus about local axis 3.
Z 22	:	0.105	[in ³]	Plastic section modulus about local axis 2.
Z 33'	:	0.844	[in ³]	Plastic section modulus about principal axis 3.
Z 22'	:	0.105	[in ³]	Plastic section modulus about principal axis 2.
Max 3	:	0.188	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 3.
Min 3	:	-0.188	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 3.
Max 2	:	1.500	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 2.
Min 2	:	-1.500	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 2.
Aw3	:	1.125	[in ²]	Flange area for shear.
Aw2	:	1.125	[in ²]	Web area for shear.
C	:	0.982	[in ³]	Torsional constant.
Qmod2'	:	2.21E+05	[in ³]	Shear modulus for principal axis 2.
Qmod3'	:	2.21E+05	[in ³]	Shear modulus for principal axis 3.

Units system: English

Load condition: LL1=Live Load Case 1

Loads

- Concentrated - Members
- Concentrated - Nodes


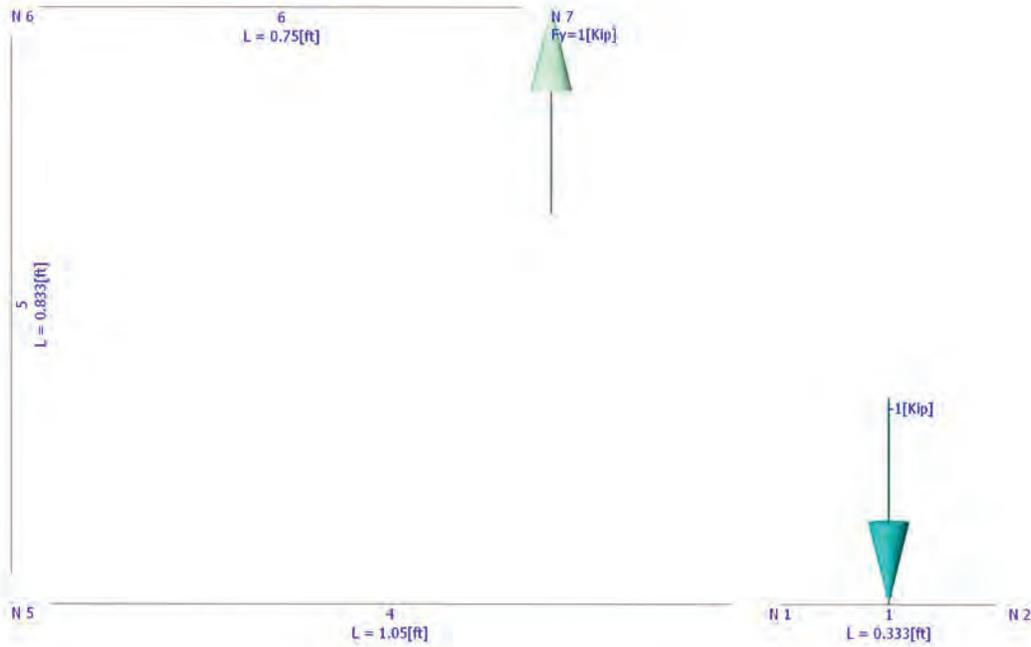


Units system: English

Load condition: LL2=Live Load Case 2

Loads

Concentrated - Nodes

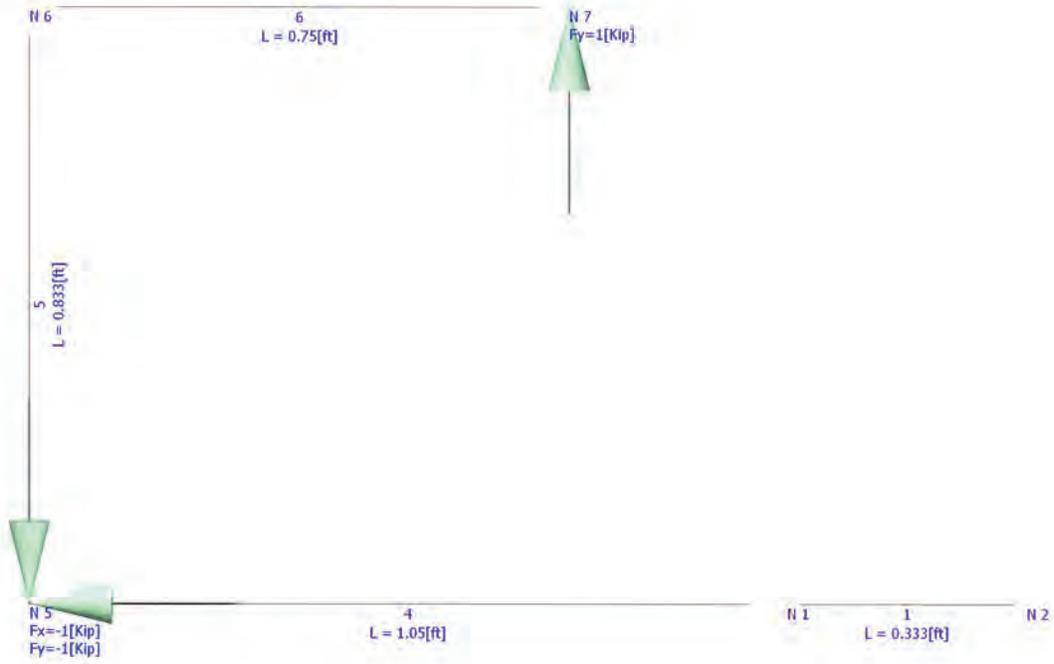

Units system: English

Load data

GLOSSARY

Comb : Indicates if load condition is a load combination


Load conditions

Condition	Description	Comb.	Category
LL1	Live Load Case 1	No	LL
LL2	Live Load Case 2	No	LL
DL	Dead Load	No	DL
LC1	1.75LL1+DL	Yes	
LC2	1.75LL2+DL	Yes	

Load on nodes

Condition	Node	FX [Kip]	FY [Kip]	FZ [Kip]	MX [Kip*ft]	MY [Kip*ft]	MZ [Kip*ft]
LL1	7	0.00	1.00	0.00	0.00	0.00	0.00
LL2	5	-1.00	-1.00	0.00	0.00	0.00	0.00
	7	0.00	1.00	0.00	0.00	0.00	0.00

Concentrated forces on members



Condition	Member	Dir1	Value1 [Kip]	Dist1 [ft]	%
LL1	1	Y	-1.00	50.00	Yes

Self weight multipliers for load conditions

Condition	Description	Self weight multiplier			
		Comb.	MultX	MultY	MultZ
LL1	Live Load Case 1	No	0.00	0.00	0.00
LL2	Live Load Case 2	No	0.00	0.00	0.00
DL	Dead Load	No	0.00	0.00	0.00
LC1	1.75LL1+DL	Yes	0.00	0.00	0.00
LC2	1.75LL2+DL	Yes	0.00	0.00	0.00

Earthquake (Dynamic analysis only)


Condition	a/g	Ang. [Deg]	Damp. [%]
LL1	0.00	0.00	0.00
LL2	0.00	0.00	0.00
DL	0.00	0.00	0.00
LC1	0.00	0.00	0.00
LC2	0.00	0.00	0.00

Units system: English

Load condition: LC1=1.75LL1+DL

Loads

- Concentrated - Members
- Concentrated - Nodes

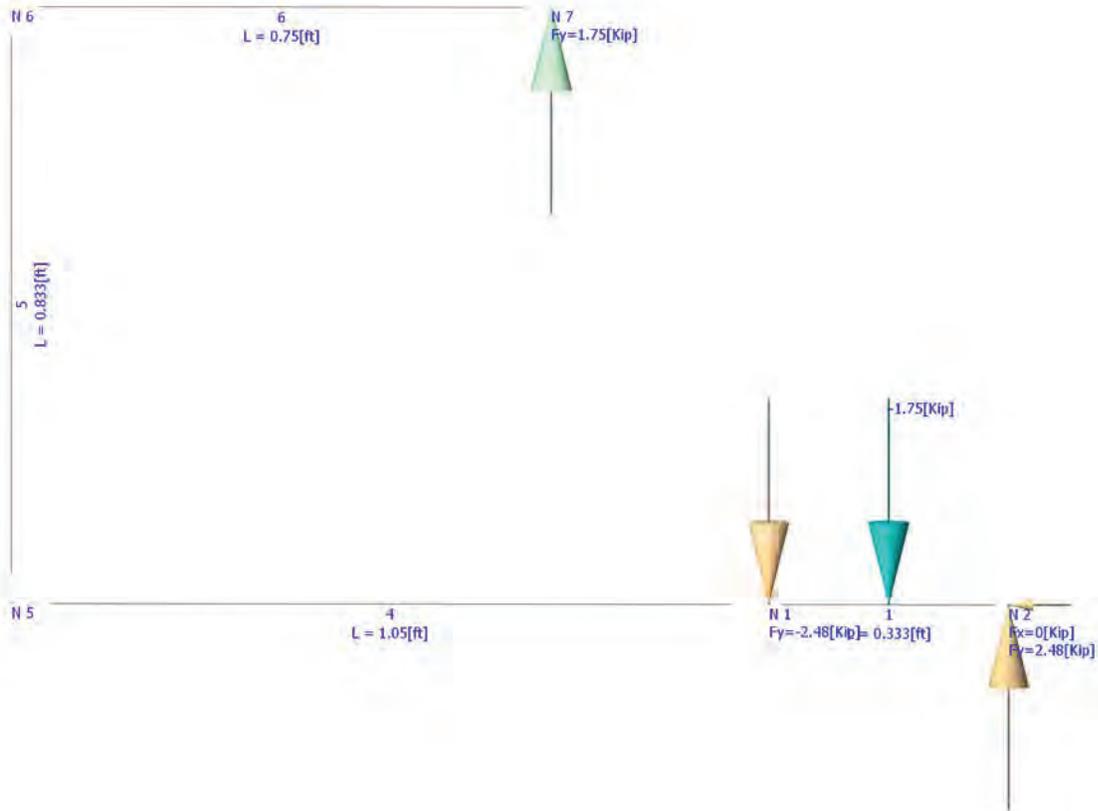


Units system: English

Load condition: LC2=1.75LL2+DL

Loads


 Concentrated - Nodes

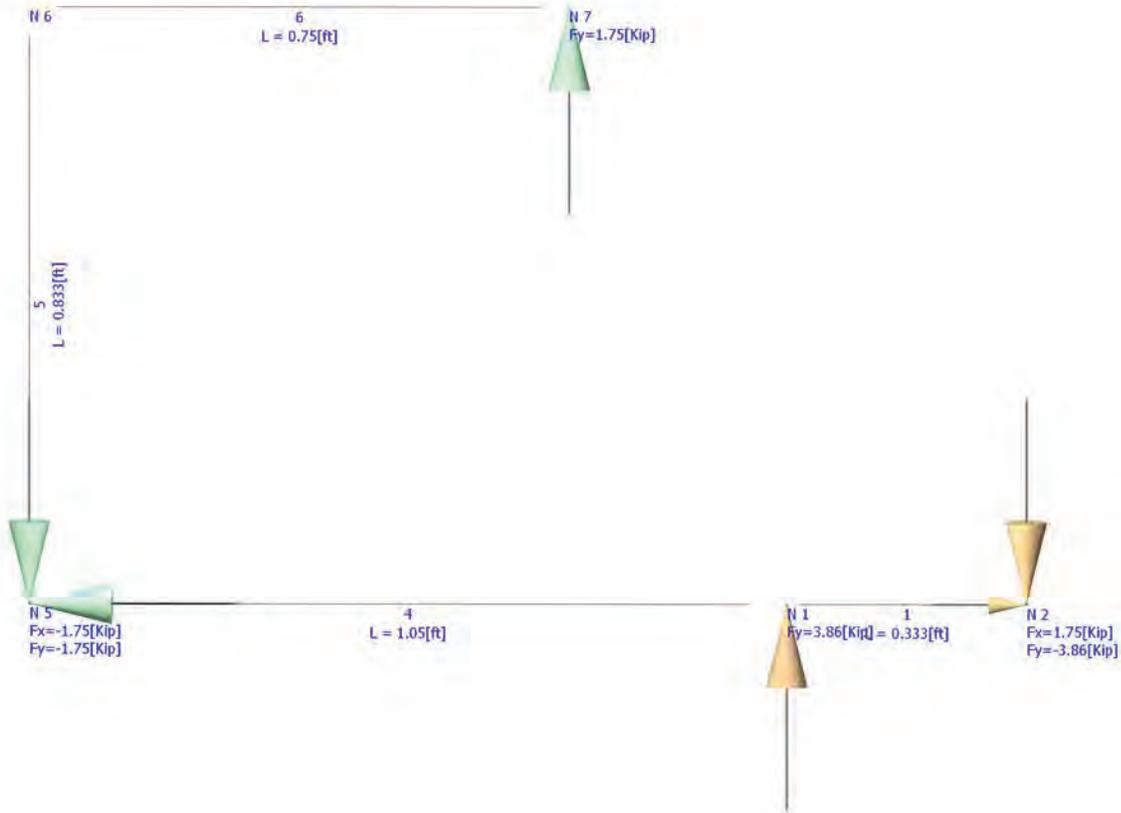

Units system: English

Analysis result

Reactions



Direction of positive forces and moments

Node	Forces [Kip]			Moments [Kip*ft]		
	FX	FY	FZ	MX	MY	MZ
Condition LC1=1.75LL1+DL						
1	0.00000	-2.48403	0.00000	0.00000	0.00000	0.00000
2	0.00000	2.48403	0.00000	0.00000	0.00000	0.00000
SUM	0.00000	0.00000	0.00000	0.00000	0.00000	0.00000
Condition LC2=1.75LL2+DL						
1	0.00000	3.85871	0.00000	0.00000	0.00000	0.00000
2	1.75000	-3.85871	0.00000	0.00000	0.00000	0.00000
SUM	1.75000	0.00000	0.00000	0.00000	0.00000	0.00000



Units system: English

Steel Code Check

Report: Summary - Group by member

Load conditions to be included in design :

LC1=1.75LL1+DL

LC2=1.75LL2+DL

Description	Section	Member	Ctrl Eq.	Ratio	Status	Reference
	<i>PL 3/8x3</i>	1	LC2 at 0.00%	0.59	OK	Eq. H1-1b
		4	LC2 at 100.00%	0.88	OK	Eq. H1-1b
		5	LC1 at 100.00%	0.89	OK	Eq. H1-1b
		6	LC1 at 0.00%	0.87	OK	Sec. F1



Subject: **Abrasive Blasting Containment Plans**
Eleven Bridges on I-91, County of Windsor, Vermont

Comp by: MAT	Date: 06/08/16	Sheet Number: _____
Check by: PRS	Job No: 187-18-1	

Available Shear Strength on Bolts:


Available Shear, 5/8" Bolt =	16.60 kips	(From Table 7-1, AISC 14th Ed.)
5/8" Bolt Area =	0.31 in. ²	
1/2" Bolt Area =	0.20 in. ²	
Available Shear, 1/2" Bolt =	<u>10.62</u> kips	
Service Design Cable Tension =	<u>5.38</u> kips	
Cable Angle =	20 deg	
ASD Shear Load on Bolts =	<u>1.84</u> kips/cable	
Number of Cables on Outrigger =	3	
Total ASD Shear Load =	<u>5.52</u> kips	
Capacity/Demand Ratio =	<u>1.92</u>	

Bolt Shear Check: OK

Available Axial Compression on HSS 4x4x1/4:

Length, L =	9.00 ft.	
Effective Length Factor, K =	1.00	(Pinned-Pinned Connection)
Effective Length Factor, K =	2.00	(Cantilever with Fixed End)
Effective Length, KL =	<u>18.00</u> ft.	(Conservative)
Pn/Ω Axial Comp., HSS 4x4x1/4 =	25.10 kips	(From Table 4-4, AISC 14th Ed.)
Total ASD Shear Load =	<u>5.52</u> kips	
Capacity/Demand Ratio =	<u>4.54</u>	

Axial Comp. Check: OK





Current Date: 6/10/2016 10:38 AM

Units system: English

File name: C:\Users\Laptop1\Desktop\Monoko\RAM R1.etz\

Geometry data

GLOSSARY

- Cb22, Cb33 : Moment gradient coefficients
- Cm22, Cm33 : Coefficients applied to bending term in interaction formula
- d0 : Tapered member section depth at J end of member
- DJX : Rigid end offset distance measured from J node in axis X
- DJY : Rigid end offset distance measured from J node in axis Y
- DJZ : Rigid end offset distance measured from J node in axis Z
- DKX : Rigid end offset distance measured from K node in axis X
- DKY : Rigid end offset distance measured from K node in axis Y
- DKZ : Rigid end offset distance measured from K node in axis Z
- dL : Tapered member section depth at K end of member
- Ig factor : Inertia reduction factor (Effective Inertia/Gross Inertia) for reinforced concrete members
- K22 : Effective length factor about axis 2
- K33 : Effective length factor about axis 3
- L22 : Member length for calculation of axial capacity
- L33 : Member length for calculation of axial capacity
- LB pos : Lateral unbraced length of the compression flange in the positive side of local axis 2
- LB neg : Lateral unbraced length of the compression flange in the negative side of local axis 2
- RX : Rotation about X
- RY : Rotation about Y
- RZ : Rotation about Z
- TO : 1 = Tension only member 0 = Normal member
- TX : Translation in X
- TY : Translation in Y
- TZ : Translation in Z

Nodes

Node	X [ft]	Y [ft]	Z [ft]	Rigid Floor
1	0.00	0.00	0.00	0
2	9.00	0.00	0.00	0
3	1.50	0.00	0.00	0
4	4.50	0.00	0.00	0
5	6.00	0.00	0.00	0
6	7.50	0.00	0.00	0
7	9.00	-1.79	0.00	0
8	6.00	-1.79	0.00	0

Restraints

Node	TX	TY	TZ	RX	RY	RZ
1	1	1	1	1	0	0
3	0	1	1	0	0	0


Members

Member	NJ	NK	Description	Section	Material	d0 [in]	dL [in]	Ig factor
1	1	3	Horiz. 4x4	HSS_SQR 4X4X1_4	A36	0.00	0.00	0.00
2	3	4	Horiz. 4x4	HSS_SQR 4X4X1_4	A36	0.00	0.00	0.00
3	4	5	Horiz. 4x4	HSS_SQR 4X4X1_4	A36	0.00	0.00	0.00
4	5	6	Horiz. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00
5	6	2	Horiz. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00
6	5	8	Vert. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00
7	2	7	Vert. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00
8	8	4	Diag. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00
9	7	6	Diag. 3x3	HSS_SQR 3X3X1_4	A36	0.00	0.00	0.00

Section information

Section name: HSS_SQR 4X4X1_4 (US)

Dimensions



a	=	4.000	[in]	Height
b	=	4.000	[in]	Width
T	=	0.233	[in]	Thickness


Properties

Ag	:	3.370	[in ²]	Gross area of the section.
I 33	:	7.800	[in ⁴]	Moment of inertia about local axis 3.
I 22	:	7.800	[in ⁴]	Moment of inertia about local axis 2.
I 23	:	0.000	[in ⁴]	Product of inertia.
Ang 3' to 3	:	0.000	--	Angle to the principal axis. (°)
I 33'	:	7.800	[in ⁴]	Moment of inertia about principal axis 3.
I 22'	:	7.800	[in ⁴]	Moment of inertia about principal axis 2.
Dist. to cg 3	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 3 direction.
Dist. to cg 2	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 2 direction.
J	:	12.800	[in ⁴]	Saint-Venant torsion constant.
Xsc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 3.
Ysc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 2.
Cw	:	0.000	[in ⁶]	Section warping constant.
ro	:	2.150	[in]	Polar radius of gyration.
J 33'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 3.
J 22'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 2.
S 33 top	:	3.900	[in ³]	Top elastic section modulus about local axis 3.
S 33 bot	:	3.900	[in ³]	Bottom elastic section modulus about local axis 3.
S 22 top	:	3.900	[in ³]	Top elastic section modulus about local axis 2.
S 22 bot	:	3.900	[in ³]	Bottom elastic section modulus about local axis 2.
S 33' top	:	3.900	[in ³]	Top elastic section modulus about principal axis 3.
S 33' bot	:	3.900	[in ³]	Bottom elastic section modulus about principal axis 3.
S 22' top	:	3.900	[in ³]	Top elastic section modulus about principal axis 2.
S 22' bot	:	3.900	[in ³]	Bottom elastic section modulus about principal axis 2.
Z 33	:	4.700	[in ³]	Plastic section modulus about local axis 3.
Z 22	:	4.700	[in ³]	Plastic section modulus about local axis 2.
Z 33'	:	4.700	[in ³]	Plastic section modulus about principal axis 3.
Z 22'	:	4.700	[in ³]	Plastic section modulus about principal axis 2.
Max 3	:	2.000	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 3.
Min 3	:	-2.000	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 3.
Max 2	:	2.000	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 2.
Min 2	:	-2.000	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 2.
Aw3	:	1.538	[in ²]	Flange area for shear.
Aw2	:	1.538	[in ²]	Web area for shear.
C	:	6.563	[in ³]	Torsional constant.
Qmod2'	:	1.74E+05	[in ³]	Shear modulus for principal axis 2.
Qmod3'	:	1.74E+05	[in ³]	Shear modulus for principal axis 3.

Section information

Section name: HSS_SQR 3X3X1_4 (US)



Dimensions



a	=	3.000	[in]	Height
b	=	3.000	[in]	Width
T	=	0.233	[in]	Thickness


Properties

Ag	:	2.440	[in ²]	Gross area of the section.
I 33	:	3.000	[in ⁴]	Moment of inertia about local axis 3.
I 22	:	3.000	[in ⁴]	Moment of inertia about local axis 2.
I 23	:	0.000	[in ⁴]	Product of inertia.
Ang 3' to 3	:	0.000	--	Angle to the principal axis. (°)
I 33'	:	3.000	[in ⁴]	Moment of inertia about principal axis 3.
I 22'	:	3.000	[in ⁴]	Moment of inertia about principal axis 2.
Dist. to cg 3	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 3 direction.
Dist. to cg 2	:	0.000	[in]	Distance from the geometric center to the gravity center of the section in the axis 2 direction.
J	:	5.080	[in ⁴]	Saint-Venant torsion constant.
Xsc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 3.
Ysc'	:	0.000	[in]	Distance from the c.g. to the shear center with reference to the principal axis 2.
Cw	:	0.000	[in ⁶]	Section warping constant.
ro	:	1.571	[in]	Polar radius of gyration.
J 33'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 3.
J 22'	:	0.000	[in]	Property to consider torsional – flexural buckling about principal axis 2.
S 33 top	:	2.000	[in ³]	Top elastic section modulus about local axis 3.
S 33 bot	:	2.000	[in ³]	Bottom elastic section modulus about local axis 3.
S 22 top	:	2.000	[in ³]	Top elastic section modulus about local axis 2.
S 22 bot	:	2.000	[in ³]	Bottom elastic section modulus about local axis 2.
S 33' top	:	2.000	[in ³]	Top elastic section modulus about principal axis 3.
S 33' bot	:	2.000	[in ³]	Bottom elastic section modulus about principal axis 3.
S 22' top	:	2.000	[in ³]	Top elastic section modulus about principal axis 2.
S 22' bot	:	2.000	[in ³]	Bottom elastic section modulus about principal axis 2.
Z 33	:	2.500	[in ³]	Plastic section modulus about local axis 3.
Z 22	:	2.500	[in ³]	Plastic section modulus about local axis 2.
Z 33'	:	2.500	[in ³]	Plastic section modulus about principal axis 3.
Z 22'	:	2.500	[in ³]	Plastic section modulus about principal axis 2.
Max 3	:	1.500	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 3.
Min 3	:	-1.500	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 3.
Max 2	:	1.500	[in]	Coordinate of the farthest positive extremity of the section in relation to local axis 2.
Min 2	:	-1.500	[in]	Coordinate of the farthest negative extremity of the section in relation to local axis 2.
Aw3	:	1.072	[in ²]	Flange area for shear.
Aw2	:	1.072	[in ²]	Web area for shear.
C	:	3.518	[in ³]	Torsional constant.
Qmod2'	:	2.36E+05	[in ³]	Shear modulus for principal axis 2.
Qmod3'	:	2.36E+05	[in ³]	Shear modulus for principal axis 3.

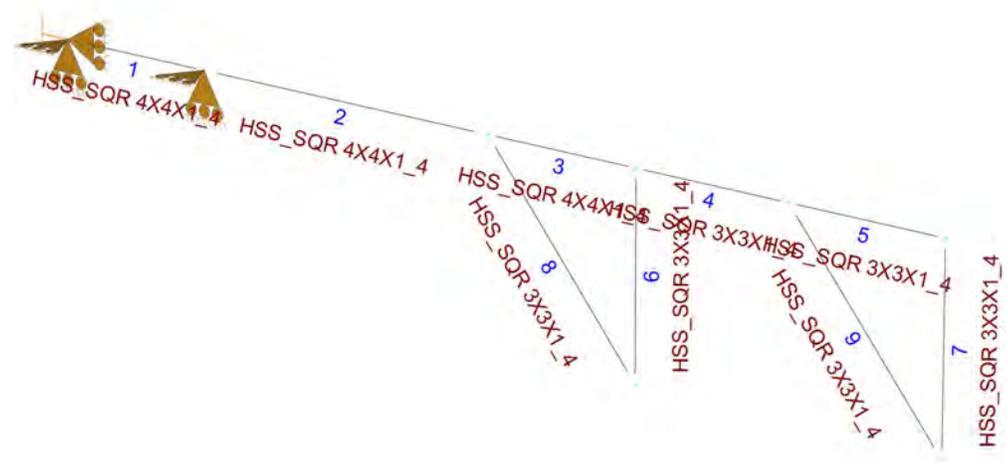

Loads

-  Bending moments
-  Concentrated - Nodes

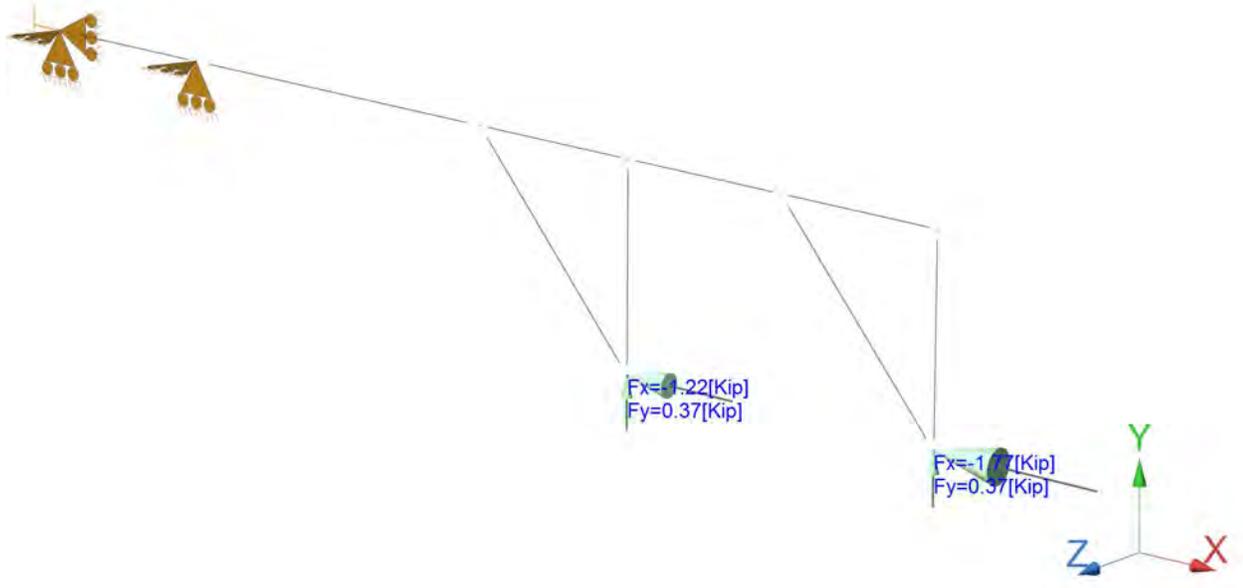



Current Date: 6/10/2016 10:40 AM

Units system: English

File name: C:\Users\Laptop1\Desktop\Monoko\RAM R1.etz\

Load data

GLOSSARY

Comb : Indicates if load condition is a load combination

Load conditions

Condition	Description	Comb.	Category
DL	Dead Load	No	DL
S1	DL	Yes	
D1	DL	Yes	

Load on nodes

Condition	Node	FX [Kip]	FY [Kip]	FZ [Kip]	MX [Kip*ft]	MY [Kip*ft]	MZ [Kip*ft]
DL	7	-1.77	0.37	0.00	0.00	0.00	0.00
	8	-1.22	0.37	0.00	0.00	0.00	0.00

Self weight multipliers for load conditions

Condition	Description	Self weight multiplier			
		Comb.	MultX	MultY	MultZ
DL	Dead Load	No	0.00	-1.00	0.00
S1	DL	Yes	0.00	0.00	0.00
D1	DL	Yes	0.00	0.00	0.00

Earthquake (Dynamic analysis only)

Condition	a/g	Ang. [Deg]	Damp. [%]
DL	0.00	0.00	0.00
S1	0.00	0.00	0.00
D1	0.00	0.00	0.00



Current Date: 6/10/2016 10:40 AM

Units system: English

File name: C:\Users\Laptop1\Desktop\Monoko\RAM R1.etz\

Steel Code Check

Report: Summary - Group by member


Load conditions to be included in design :


D1=DL

Description	Section	Member	Ctrl Eq.	Ratio	Status	Reference
<u>Diag. 3x3</u>	<i>HSS_SQR 3X3X1_4</i>	8	D1 at 100.00%	0.17	OK	Eq. H1-1b
		9	D1 at 100.00%	0.19	OK	Eq. H1-1b
<u>Horiz. 3x3</u>		4	D1 at 100.00%	0.41	OK	Eq. H1-1b
		5	D1 at 0.00%	0.23	OK	Eq. H1-1b
<u>Horiz. 4x4</u>	<i>HSS_SQR 4X4X1_4</i>	1	D1 at 100.00%	0.15	OK	Eq. H1-1b
		2	D1 at 100.00%	0.29	OK	Eq. H1-1b
		3	D1 at 0.00%	0.20	OK	Eq. H1-1b
<u>Vert. 3x3</u>	<i>HSS_SQR 3X3X1_4</i>	6	D1 at 0.00%	0.14	OK	Eq. H1-1b
		7	D1 at 100.00%	0.06	OK	Eq. H1-1b

Internal forces


■ Bending moment

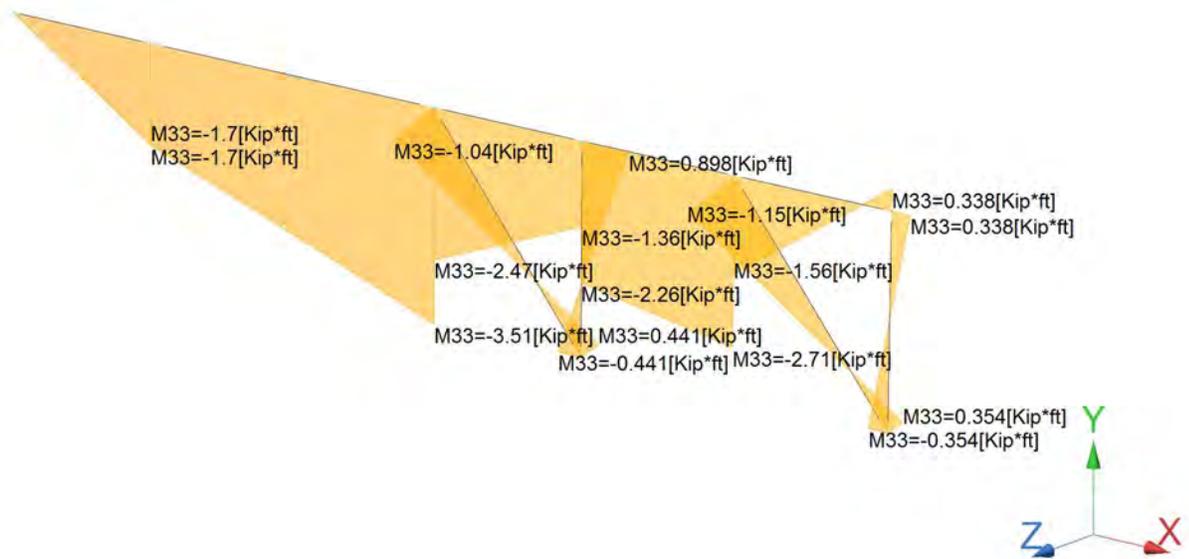

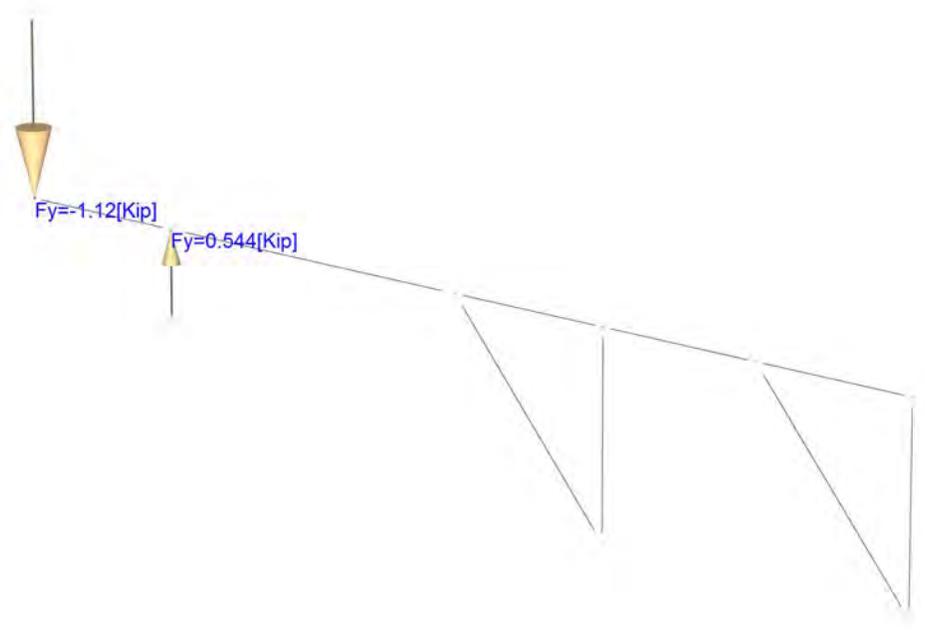


Design status

- Not designed
- Error on design
- Design O.K.
- With warnings

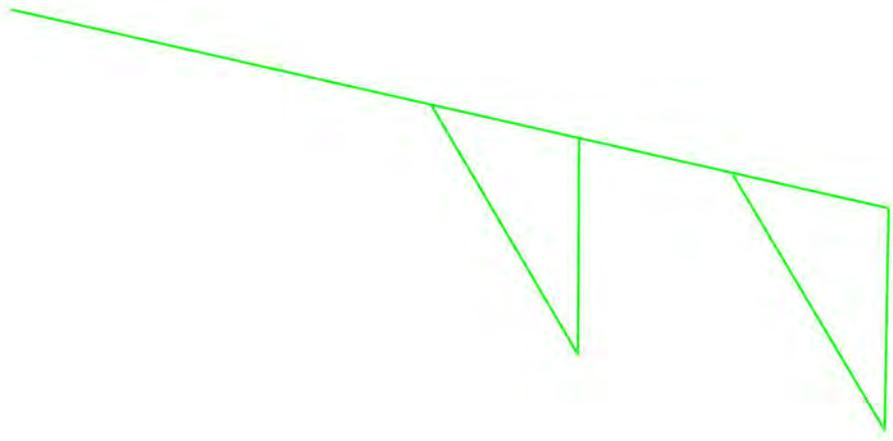

B, BA, BV DECK

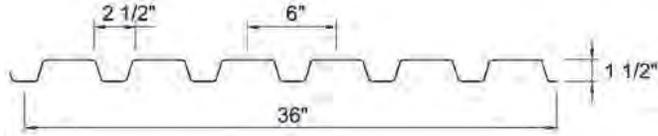

Height	1 1/2 in.
Fy (minimum)	33 ksi
Modulus of Elasticity	29500 ksi

SECTION PROPERTIES

Gage	Fy (ksi)	Coverage (in)	Thickness (in)	Weight (psf)	I (in ⁴ /ft)	Sp (in ³ /ft)	Sn (in ³ /ft)
22	33	36	0.0295	1.63	0.177	0.189	0.198
20	33	36	0.0358	1.96	0.213	0.235	0.247
18	33	36	0.0474	2.57	0.290	0.315	0.316

ALLOWABLE UNIFORM LOADS

Span Condition	Gage	Allowable Total (Dead + Live) Uniform Load (psf)										Max. Constr. Span (ctr. to ctr.)
		Center to Center Span (ft. - in.)										
		5 - 0	5 - 6	6 - 0	6 - 6	7 - 0	7 - 6	8 - 0	8 - 6	9 - 0	9 - 6	
Single	22	91	71	57	47	40	34	30	27	24	22	5 - 8
	20	111	86	69	56	47	40	35	31	27	25	6 - 7
	18	130	113	94	76	63	53	46	40	35	31	8 - 2
Double	22	107	88	74	63	54	47	42	37	33	30	6 - 8
	20	133	110	92	79	68	59	52	46	41	37	7 - 10
	18	170	140	118	101	87	76	66	59	53	47	9 - 6
Triple	22	133	110	93	79	68	59	50	44	38	34	6 - 9
	20	166	137	115	98	84	70	59	51	45	39	7 - 11
	18	213	176	146	125	107	93	78	67	58	51	9 - 8

Notes

- Section properties are calculated using the AISI Cold Formed Steel Design Specifications, 1996 Edition.
- Loads and maximum construction spans are based on the SDI Design Manual for Composite Decks, Form Decks and Roof Decks, Publication No. 30.
- Maximum cantilever spans are based on SDI criteria and are sensitive to adjacent spans. For this table, adjacent span is assumed to be at least 1.5 times longer than the cantilever span.
- Minimum end bearing length shall be 1 1/2".
- Loads shown in **RED** are governed by the live load deflection not in excess of 1/240 of span. 10 psf dead load has been included.
- Perforations which are placed in the vertical ribs of type BA deck reduce the strength less than 5%.

FACTORY MUTUAL SPANS

Gage	Max. Ctr. to Ctr. Span (ft.-in.)
22	6 - 0
20	6 - 6
18	7 - 5

CANTILEVER SPANS

Gage	Maximum Cantilever Span (ft.-in.)
22	2 - 0
20	2 - 4
18	2 - 8

- Type B deck provides the best balance of strength and economy of all the 1 1/2" deep roof decks. 1" (minimum) rigid roofing insulation is required to be used with type B deck.
- Available with nested side laps only.
- Available as an acoustic deck. Type BA deck is manufactured with perforations in the vertical ribs, having a NRC rating of 0.60 with 1 1/2" (minimum) rigid roofing insulation.
- Available as a vented deck. Type BV deck is manufactured with slot vents in the bottom flutes. The openings equal 0.5% of total surface. Type BV deck is to be specified when venting is required for cementitious insulation fills. Type BV deck is manufactured at our Lake City, FL facility only.
- Type B deck is Factory Mutual approved. Type BA and BV decks are not Factory Mutual approved.
- Type B, BA and BV decks are manufactured from steel conforming to ASTM A1008-00 Grades C, D or E or from A653/A653M-00 structural quality grade SQ33 or higher. The minimum yield strength used by NMBS is 33 KSI.
- Minimum attachment to supporting structural members requires connections at all side lap ribs plus a sufficient number of interior ribs to limit the spacing between connections to 18". Side laps are to be fastened together between supports, at a maximum spacing of 36" o.c. whenever the deck span exceeds 5'-0". Connections can be made either by welding using a minimum 5/8" diameter puddle weld or properly designed mechanical fasteners.



or go to the [Advance Search](#)

[HOME](#) [Products](#) [Technical Data](#) [Applications Guide](#) [Literature](#) [Contact Us](#)

Trubolt Wedge Type Anchor
Performance Data (2 pages)
[Product Information: Suggested Specifications](#)
[Selection and Order Information \(2 pages\)](#)
[Installation Instructions: Approvals and Listing](#)

PERFORMANCE TABLE

Trubolt Wedge Anchors			Ultimate Tension and Shear Values (Lbs/kN) in Concrete*						
ANCHOR DIA In. (mm)	INSTALLATION TORQUE Ft. Lbs (Nm)	EMBEDMENT DEPTH In. (mm)	ANCHOR TYPE	f'c = 2000 PSI (13.8 MPa)		f'c = 4000 PSI (27.6 MPa)		f'c = 6000 PSI (41.4 MPa)	
				TENSION Lbs. (kN)	SHEAR Lbs. (kN)	TENSION Lbs. (kN)	SHEAR Lbs. (kN)	TENSION Lbs. (kN)	SHEAR Lbs. (kN)
1/4 (6.4)	4 (5.4)	1-1/8 (28.6)	WS-Carbon or WS-G Hot-Dipped Galvanized or WW-304 S.S. or SWS-316 S.S.	1,180 (5.2)	1,400 (6.2)	1,780 (7.9)	1,400 (6.2)	1,900 (8.5)	1,400 (6.2)
		1-15/16 (49.2)		2,100 (9.3)	1,680 (7.5)	3,300 (14.7)	1,680 (7.5)	3,300 (14.7)	1,680 (7.5)
		2-1/8 (54.0)		2,260 (10.1)	1,680 (7.5)	3,300 (14.7)	1,680 (7.5)	3,300 (14.7)	1,680 (7.5)
3/8 (9.5)	25 (33.9)	1-1/2 (38.1)		1,680 (7.5)	2,320 (10.3)	2,240 (10.0)	2,620 (10.3)	2,840 (12.6)	3,160 (14.1)
		3 (76.2)		3,480 (15.5)	4,000 (17.8)	5,940 (26.4)	4,140 (18.4)	6,120 (27.2)	4,500 (20.0)
		4 (101.6)		4,800 (21.4)	4,000 (17.8)	5,940 (26.4)	4,140 (18.4)	6,120 (27.2)	4,500 (20.0)
1/2 (12.7)	55 (74.6)	2-1/4 (57.2)		4,660 (20.7)	4,760 (21.2)	5,100 (22.7)	4,760 (21.2)	7,040 (31.3)	7,040 (31.3)
		4-1/8 (104.8)		4,660 (20.7)	7,240 (32.2)	9,640 (42.9)	7,240 (32.2)	10,820 (48.1)	8,160 (36.3)
		6 (152.4)		5,340 (23.8)	7,240 (32.2)	9,640 (42.9)	7,240 (32.2)	10,820 (48.1)	8,160 (36.3)
5/8 (15.9)	90 (122.0)	2-3/4 (69.9)		6,580 (29.3)	7,120 (31.7)	7,180 (31.9)	7,120 (31.7)	9,720 (43.2)	9,616 (42.8)
		5-1/8 (130.2)	6,580 (29.3)	9,600 (42.7)	14,920 (66.4)	11,900 (52.9)	16,380 (72.9)	12,520 (55.7)	
		7-1/2 (190.5)	7,060 (31.4)	9,600 (42.7)	15,020 (66.8)	11,900 (52.9)	16,380 (72.9)	12,520 (55.7)	
3/4 (19.1)	110 (149.2)	3-1/4 (82.6)	7,120 (31.7)	10,120 (45.0)	10,840 (48.2)	13,720 (61.0)	13,300 (59.2)	15,980 (71.1)	
		6-5/8 (168.3)	10,980 (48.8)	20,320 (90.4)	17,700 (78.7)	23,740 (105.6)	20,260 (90.1)	23,740 (105.6)	
		10 (254.0)	10,980 (48.8)	20,320 (90.4)	17,880 (79.5)	23,740 (105.6)	23,580 (104.9)	23,740 (105.6)	
7/8 (22.2)	250 (339.6)	3-3/4 (93.3)	9,520 (42.3)	13,160 (58.5)	14,740 (65.6)	16,580 (73.8)	17,420 (77.5)	19,160 (85.2)	
		6-1/4 (158.8)	14,660 (65.2)	20,880 (92.9)	20,940 (93.1)	28,800 (128.1)	24,360 (108.4)	28,800 (128.1)	
		8 (203.2)	14,660 (65.2)	20,880 (92.9)	20,940 (93.1)	28,800 (128.1)	24,360 (108.4)	28,800 (128.1)	
1 (25.4)	300 (406.7)	4-1/2 (114.3)	13,940 (62.0)	16,080 (71.5)	20,180 (89.8)	22,820 (101.5)	21,180 (94.2)	24,480 (108.9)	
		7-3/8 (187.3)	14,600 (64.9)	28,680 (127.6)	23,980 (106.7)	37,940 (168.8)	33,260 (148.0)	38,080 (169.4)	
		9-1/2 (241.3)	18,700 (83.2)	28,680 (127.6)	26,540 (118.1)	37,940 (168.8)	33,260 (148.0)	38,080 (169.4)	

* Allowable values are based upon a 4 to 1 safety factor. Divide by 4 for allowable load values.
 * For Tie-Wire Wedge Anchor, TW-1400, use tension data from 1/4" diameter with 1-1/8" embedment.

PERFORMANCE TABLE

Trubolt Wedge Anchors			Ultimate Tension and Shear Values (Lbs/kN) in Lightweight Concrete*				
ANCHOR DIA In. (mm)	INSTALLATION TORQUE Ft. Lbs (Nm)	EMBEDMENT DEPTH In. (mm)	ANCHOR TYPE	LIGHTWEIGHT CONCRETE f'c = 3000 PSI 20.7 MPa)		LOWER FLUTE OF STEEL DECK WITH LIGHTWEIGHT CONCRETE FILL f'c = 2000 PSI (13.8 MPa)	
				TENSION Lbs. (kN)	SHEAR Lbs. (kN)	TENSION Lbs. (kN)	SHEAR Lbs. (kN)
3/8 (9.5)	25 (33.9)	1-1/2 (38.1)	WS-Carbon or WS-G Hot-Dipped Galvanized or WW-304 S.S. or SWS-316 S.S.	1,175 (5.2)	1,480 (6.6)	1,900 (8.5)	3,160 (14.1)
		3 (76.2)		2,825 (12.6)	2,440 (10.9)	2,840 (12.6)	4,000 (17.8)
1/2 (12.7)	55 (74.6)	2-1/4 (57.2)		2,925 (13.0)	2,855 (12.7)	3,400 (15.1)	5,380 (23.9)
		3 (76.2)		3,470 (15.4)	3,450 (15.3)	4,480 (19.9)	6,620 (29.4)
		4 (101.6)		4,290 (19.1)	3,450 (15.3)	4,800 (21.4)	6,440 (28.6)
5/8 (15.9)	90 (122.0)	3 (76.2)		4,375 (19.5)	4,360 (19.4)	4,720 (21.0)	5,500 (24.5)
		5 (127.0)		6,350 (28.2)	6,335 (28.2)	6,580 (29.3)	9,140 (40.7)
3/4 (19.1)	110 (149.2)	3-1/4 (82.6)		5,390 (24.0)	7,150 (31.8)	5,840 (26.0)	8,880 (39.5)
		5-1/4 (133.4)	7,295 (32.5)	10,750 (47.8)	7,040 (31.3)	---	

* Allowable values are based upon a 4 to 1 safety factor. Divide by 4 for allowable load values.

Forged Wire Rope Clips



SEE APPLICATION AND WARNING INFORMATION

Para Español: www.thecrosbygroup.com

On Page 56


G-450



- Each base has a Product Identification Code (PIC) for material traceability, the name CROSBY or CG, and a size forged into it.
- Based on the catalog breaking strength of wire rope, Crosby wire rope clips have an efficiency rating of 80% for 1/8" - 7/8" sizes, and 90% for sizes 1" through 3-1/2".
- Entire Clip-Galvanized to resist corrosive and rusting action.
- Sizes 1/8" through 2-1/2" and 3" have forged bases.
- All Clips are individually bagged or tagged with proper application instructions and warning information.
- Clip sizes up through 1-1/2" have rolled threads.
- Meets or exceeds all requirements of ASME B30.26 including identification, ductility, design factor, proof load and temperature requirements. Importantly, these wire rope clips meet other critical performance requirements including fatigue life, impact properties and material traceability, not addressed by ASME B30.26.
- Look for the Red-U-Bolt®, your assurance of Genuine Crosby Clips.

Crosby Clips, all sizes 1/4" and larger, meet the performance requirements of Federal Specification FF-C-450 TYPE 1 CLASS 1, except for those provisions required of the contractor. For additional information, see page 444.

G-450 Crosby® Clips

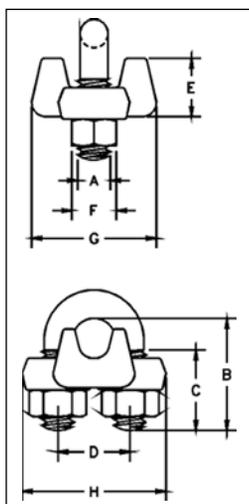

Rope Size		G-450 Stock No.	Std. Package Qty.	Weight Per 100 (lbs.)	Dimensions (in.)							
(in.)	(mm)				A	B	C	D	E	F	G	H
1/8	3-4*	1010015	100	6	.22	.72	.44	.47	.37	.38	.81	.99
3/16*	5*	1010033	100	10	.25	.97	.56	.59	.50	.44	.94	1.18
1/4	6-7	1010051	100	19	.31	1.03	.50	.75	.66	.56	1.19	1.43
5/16	8	1010079	100	28	.38	1.38	.75	.88	.73	.69	1.31	1.66
3/8	9-10	1010097	100	48	.44	1.50	.75	1.00	.91	.75	1.63	1.94
7/16	11	1010113	50	78	.50	1.88	1.00	1.19	1.13	.88	1.91	2.28
1/2	12-13	1010131	50	80	.50	1.88	1.00	1.19	1.13	.88	1.91	2.28
9/16	14-15	1010159	50	109	.56	2.25	1.25	1.31	1.34	.94	2.06	2.50
5/8	16	1010177	50	110	.56	2.25	1.25	1.31	1.34	.94	2.06	2.50
3/4	18-20	1010195	25	142	.62	2.75	1.44	1.50	1.39	1.06	2.25	2.84
7/8	22	1010211	25	212	.75	3.12	1.62	1.75	1.58	1.25	2.44	3.16
1	24-26	1010239	10	252	.75	3.50	1.81	1.88	1.77	1.25	2.63	3.47
1-1/8	28-30	1010257	10	283	.75	3.88	2.00	2.00	1.91	1.25	2.81	3.59
1-1/4	32-34	1010275	10	438	.88	4.44	2.22	2.34	2.17	1.44	3.13	4.13
1-3/8	36	1010293	10	442	.88	4.44	2.22	2.34	2.31	1.44	3.13	4.19
1-1/2	38	1010319	10	544	.88	4.94	2.38	2.59	2.44	1.44	3.41	4.44
1-5/8	41-42	1010337	Bulk	704	1.00	5.31	2.62	2.75	2.66	1.63	3.63	4.75
1-3/4	44-46	1010355	Bulk	934	1.13	5.75	2.75	3.06	2.92	1.81	3.81	5.24
2	48-52	1010373	Bulk	1300	1.25	6.44	3.00	3.38	3.03	2.00	4.44	5.88
2-1/4	56-58	1010391	Bulk	1600	1.25	7.13	3.19	3.88	3.19	2.00	4.56	6.38
2-1/2	62-65	1010417	Bulk	1900	1.25	7.69	3.44	4.13	3.69	2.00	4.69	6.63
** 2-3/4	** 68-72	1010435	Bulk	2300	1.25	8.31	3.56	4.38	4.88	2.00	5.00	6.88
3	75-78	1010453	Bulk	3100	1.50	9.19	3.88	4.75	4.44	2.38	5.31	7.61
** 3-1/2	** 85-90	1010426	Bulk	4000	1.50	10.75	4.50	5.50	6.00	2.38	6.19	8.38

* Electro-plated U-Bolt and Nuts. ** 2-3/4" and 3-1/2" base is made of cast steel.

- Each base has a Product Identification Code (PIC) for material traceability, the name CROSBY or "CG", and a size forged into it.
- Entire clip is made from 316 Stainless Steel to resist corrosive and rusting action.
- All components are Electro-Polished.
- All Clips are individually bagged or tagged with proper application instructions and warning information.

SS-450



SS-450 Stainless Steel Wire Rope Clips

Rope Size		SS-450 Stock No.	Std. Package Qty.	Weight Per 100 (lbs.)	Dimensions (in.)							
(in.)	(mm)				A	B	C	D	E	F	G	H
1/8	3-4	1011250	Bulk	6	.22	.72	.44	.47	.41	.38	.81	.94
3/16	5	1011261	Bulk	10	.25	.97	.56	.59	.50	.44	.94	1.16
1/4	6-7	1011272	Bulk	20	.31	1.03	.50	.75	.66	.56	1.19	1.44
3/8	9-10	1011283	Bulk	47	.44	1.50	.75	1.00	.91	.75	1.63	1.94
1/2	12-13	1011305	Bulk	77	.50	1.88	1.00	1.19	1.13	.88	1.91	2.28
5/8	16	1011327	Bulk	106	.56	2.38	1.25	1.31	1.34	.94	2.06	2.50

CROSBY® CLIPS WARNINGS AND APPLICATION INSTRUCTIONS



G-450
(Red-U-Bolt®)



SS-450
(316 Stainless Steel)

⚠️WARNING

- Failure to read, understand, and follow these instructions may cause death or serious injury.
- Read and understand these instructions before using clips.
- Match the same size clip to the same size wire rope.
- Prepare wire rope end termination only as instructed.
- Do not use with plastic coated wire rope.
- Apply first load to test the assembly. This load should be of equal or greater weight than loads expected in use. Next, check and retighten nuts to recommended torque (See Table 1).

Efficiency ratings for wire rope end terminations are based upon the minimum breaking force of wire rope. The efficiency rating of a properly prepared loop or thimble-eye termination for clip sizes 32 mm through 22mm is 80%, and for sizes 25.5 mm through 88.9 mm is 90%.

The number of clips shown (see Table 1) is based upon using RRL or RLL wire rope, 6 x 19 or 6 x 36 Class, FC or IWRC; IPS or XIP, XXIP. If Seale construction or similar large outer wire type construction in the 6 x 19 Class is to be used for sizes 1 inch and larger, add one additional clip. If a pulley (sheave) is used for turning back the wire rope, add one additional clip.

The number of clips shown also applies to rotation-resistant RRL wire rope, 8 x 19 Class, IPS, XIP, XXIP sizes 1-1/2 inch and smaller; and to rotation-resistant RLL wire rope, 19 x 7 Class, IPS, XIP, XXIP sizes 1-3/4 inch and smaller.

For other classes of wire rope not mentioned above, we recommend contacting Crosby Engineering to ensure the desired efficiency rating.

For elevator, personnel hoist, and scaffold applications, refer to ANSI A17.1 and ANSI A10.4. These standards do not recommend U-Bolt style wire rope clip terminations. The style wire rope termination used for any application is the obligation of the user.

For OSHA (Construction) applications, see OSHA 1926.251.

1. Refer to Table 1 in following these instructions. Turn back specified amount of rope from thimble or loop.



Figure 1

Apply first clip one base width from dead end of rope. Apply U-Bolt over dead end of wire rope – live end rests in saddle (Never saddle a dead horse!). Use torque wrench to tighten nuts evenly, alternate from one nut to the other until reaching the recommended torque. (See Figure 1)

2. When two clips are required, apply the second clip as near the loop or thimble as possible. Use torque wrench to tighten



Figure 2

nuts evenly, alternating until reaching the recommended torque. When more than two clips are required, apply the second clip as near the loop or thimble as possible, turn nuts on second clip firmly, but do not tighten. (See Figure 2)

Include 4 cable clips

3. When three or more clips are required, space additional clips equally between first two – take up rope slack – use torque wrench to tighten nuts on each U-Bolt evenly, alternating from one nut to the other until reaching recommended torque.



Figure 3

(See Figure 3)
4. If a pulley (sheave) is used in place of a thimble, add one additional clip. Clip spacing should be as shown. (See Figure 4)

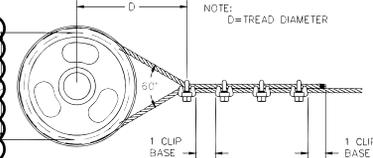


Figure 4

5. WIRE ROPE SPLICING PROCEDURES:

The preferred method of splicing two wire ropes together is to use inter-locking turnback eyes with thimbles using the recommended number of clips on each eye (See Figure 5).

An alternate method is to use twice the number of clips as used for a turnback termination. The rope ends are placed parallel to each other, overlapping by twice the turnback amount shown in the application instructions. The minimum number of clips should be installed on each dead end (See Figure 6). Spacing, installation torque, and other instructions still apply.



Figure 5

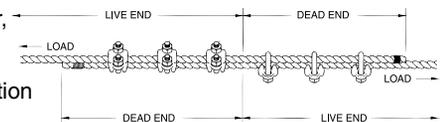


Figure 6

6. IMPORTANT

Apply first load to test the assembly. This load should be of equal or greater weight than loads expected in use. Next, check and use torque wrench to retighten nuts to recommended torque. In accordance with good rigging and maintenance practices, the wire rope end termination should be inspected periodically for wear, abuse, and general adequacy.

Table 1

Clip Size (in.)	Rope Size (mm)	Minimum No. of Clips	Amount of Rope to Turn Back in mm	*Torque in Nm
1/8	3-4	2	85	6.1
3/16	5	2	95	10.2
1/4	6-7	2	120	20.3
5/16	8	2	133	26.7
3/8	9-10	2	165	61.0
7/16	11-12	2	178	68
1/2	13	3	292	88
9/16	14-15	3	305	129
5/8	16	3	305	129
3/4	19-20	4	468	176
7/8	22	4	480	305
1	24-25	5	660	305
1-1/8	28-30	6	860	305
1-1/4	33-34	7	1120	488
1-3/8	36	7	1120	488
1-1/2	38-40	8	1370	488
1-5/8	41-42	8	1470	583
1-3/4	44-46	8	1550	800
2	48-52	8	1800	1017
2-1/4	56-58	8	1850	1017
2-1/2	62-65	9	2130	1017
2-3/4	68-72	10	2540	1017
3	75-78	10	2690	1627
3-1/2	85-90	12	3780	1627

If a pulley (sheave) is used for turning back the wire rope, add one additional clip. See Figure 4.

If a greater number of clips are used than shown in the table, the amount of turnback should be increased proportionately.

*The tightening torque values shown are based upon the threads being clean, dry, and free of lubrication.

Crosby® Round Pin Shackles

Load Rated

Fatigue Rated

"QT"
QUENCHED & TEMPERED

QUIC-CHECK®

MAXTOUGH®

ROUND PIN ANCHOR SHACKLES



G-213 S-213

Round pin anchor shackles meet the performance requirements of Federal Specification RR-C-271D Type IVA, Grade A, Class 1, except for those provisions required of the contractor.

- Capacities 1/2 thru 35 metric tons.
- Forged - Quenched and Tempered, with alloy pins.
- Working Load Limit permanently shown on every shackle.
- Hot Dip galvanized or Self Colored.
- Fatigue rated.
- Shackles 25t and larger are **RFID EQUIPPED**.
- Shackles can be furnished proof tested with certificates to designated standards, such as ABS, DNV, Lloyds, or other certification. Charges for proof testing and certification available when requested at the time of order.
- Shackles are Quenched and Tempered and can meet DNV impact requirements of 42 joules at -20 degree C.
- Look for the Red Pin® . . . the mark of genuine Crosby quality.




ROUND PIN CHAIN SHACKLES




G-215 S-215

Round pin chain shackles meet the performance requirements of Federal Specification RR-C-271D Type IVB, Grade A, Class 1, except for those provisions required of the contractor.

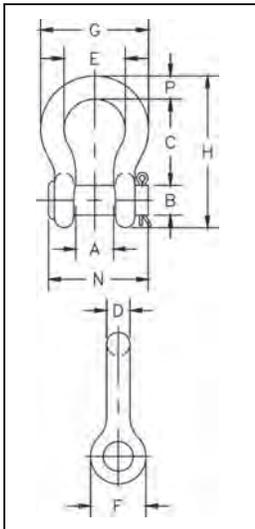

G-213 S-213

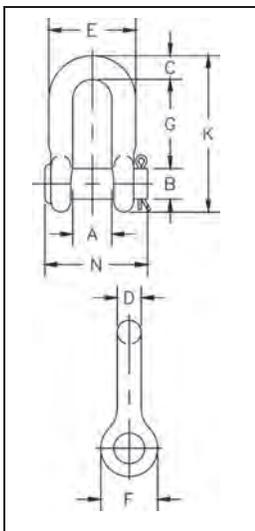

G-215 S-215

Nominal Size (in.)	Working Load Limit (t)*	Stock No.		Weight Each (lbs.)	Dimensions (in.)													Tolerance +/-	
		G-213	S-213		A	B	C	D	E	F	G	H	N	P	C	A			
1/4	1/2	1018017	1018026	.13	.47	.31	1.13	.25	.78	.61	1.28	1.84	1.34	.25	.06	.06			
5/16	3/4	1018035	1018044	.18	.53	.38	1.22	.31	.84	.75	1.47	2.09	1.59	.31	.06	.06			
3/8	1	1018053	1018062	.29	.66	.44	1.44	.38	1.03	.91	1.78	2.49	1.86	.38	.13	.06			
7/16	1-1/2	1018071	1018080	.38	.75	.50	1.69	.44	1.16	1.06	2.03	2.91	2.13	.44	.13	.06			
1/2	2	1018099	1018106	.71	.81	.63	1.88	.50	1.31	1.19	2.31	3.28	2.38	.50	.13	.06			
5/8	3-1/4	1018115	1018124	1.50	1.06	.75	2.38	.63	1.69	1.50	2.94	4.19	2.91	.69	.13	.06			
3/4	4	1018133	1018142	2.32	1.25	.88	2.81	.75	2.00	1.81	3.50	4.97	3.44	.81	.25	.06			
7/8	6-1/2	1018151	1018160	3.49	1.44	1.00	3.31	.88	2.28	2.09	4.03	5.83	3.81	.97	.25	.06			
1	8-1/2	1018179	1018188	5.00	1.69	1.13	3.75	1.00	2.69	2.38	4.69	6.56	4.53	1.06	.25	.06			
1-1/8	9-1/2	1018197	1018204	6.97	1.81	1.25	4.25	1.13	2.91	2.69	5.16	7.47	5.13	1.25	.25	.06			
1-1/4	12	1018213	1018222	9.75	2.03	1.38	4.69	1.29	3.25	3.00	5.75	8.25	5.50	1.38	.25	.06			
1-3/8	13-1/2	1018231	1018240	13.25	2.25	1.50	5.25	1.42	3.63	3.31	6.38	9.16	6.13	1.50	.25	.13			
1-1/2	17	1018259	1018268	17.25	2.38	1.63	5.75	1.54	3.88	3.63	6.88	10.00	6.50	1.62	.25	.13			
1-3/4	25	1018277	1018286	29.46	2.88	2.00	7.00	1.84	5.00	4.19	8.86	12.34	7.75	2.25	.25	.13			
2	35	1018295	1018302	45.75	3.25	2.25	7.75	2.08	5.75	4.81	9.97	13.68	8.75	2.40	.25	.13			

* NOTE: Maximum Proof Load is 2.0 times the Working Load Limit. Minimum Ultimate Strength is 6 times the Working Load Limit.

Nominal Size (in.)	Working Load Limit (t)*	Stock No.		Weight Each (lbs.)	Dimensions (in.)													Tolerance +/-	
		G-215	S-215		A	B	C	D	E	F	G	K	N	G	A				
1/4	1/2	1018810	1018829	.10	.47	.31	.25	.25	.97	.62	.91	1.59	1.34	.06	.06				
5/16	3/4	1018838	1018847	.18	.53	.38	.31	.31	1.15	.75	1.07	1.91	1.63	.06	.06				
3/8	1	1018856	1018865	.25	.66	.44	.38	.38	1.42	.92	1.28	2.31	1.86	.13	.06				
7/16	1-1/2	1018874	1018883	.40	.75	.50	.44	.44	1.63	1.06	1.48	2.67	2.13	.13	.06				
1/2	2	1018892	1018909	.50	.81	.63	.50	.50	1.81	1.18	1.66	3.03	2.38	.13	.06				
5/8	3-1/4	1018918	1018927	1.21	1.06	.75	.63	.63	2.32	1.50	2.04	3.76	2.91	.13	.06				
3/4	4-3/4	1018936	1018945	2.00	1.25	.88	.81	.75	2.75	1.81	2.40	4.53	3.44	.25	.06				
7/8	6-1/2	1018954	1018963	3.28	1.44	1.00	.97	.88	3.20	2.10	2.86	5.33	3.81	.25	.06				
1	8-1/2	1018972	1018981	4.75	1.69	1.13	1.00	1.00	3.69	2.38	3.24	5.94	4.53	.25	.06				
1-1/8	9-1/2	1018990	1019007	6.30	1.81	1.25	1.25	1.13	4.07	2.68	3.61	6.78	5.13	.25	.06				
1-1/4	12	1019016	1019025	9.00	2.03	1.38	1.38	1.25	4.53	3.00	3.97	7.50	5.50	.25	.13				
1-3/8	13-1/2	1019034	1019043	12.00	2.25	1.50	1.50	1.38	5.01	3.31	4.43	8.28	6.13	.25	.13				
1-1/2	17	1019052	1019061	16.15	2.38	1.63	1.62	1.50	5.38	3.62	4.87	9.05	6.50	.25	.13				
1-3/4	25	1019070	1019089	29.96	2.88	2.00	2.12	1.75	6.38	4.19	5.82	10.97	7.75	.25	.13				
2	35	1019098	1019105	43.25	3.25	2.25	2.36	2.10	7.25	5.00	6.82	12.74	8.75	.25	.13				

* NOTE: Maximum Proof Load is 2.0 times the Working Load Limit. Minimum Ultimate Strength is 6 times the Working Load Limit.

Copyright © 2008 The Crosby Group, Inc.
All Rights Reserved



Crosby® Eye Hooks

Load Rated Fatigue Rated "QT"



SEE APPLICATION AND WARNING INFORMATION
 Para Español: www.thecrosbygroup.com On Pages 140-141

S-320 & S-320N EYE HOOKS



All Crosby 320 Eye Hoist Hooks incorporate the following features:

- The most complete line of Eye hoist hooks.
- Available in carbon steel and alloy steel.
- Designed with a 5:1 Design Factor for (Carbon Steel); 4.5:1 Design Factor for 30t - 60t (Alloy Steel).
- Eye hooks are load rated.
- Proper design, careful forging and precision controlled quenched and tempering give maximum strength without excessive weight and bulk.
- Every Crosby Eye Hook has a pre-drilled cam which can be equipped with a latch. Even years after purchase of the original hook, latch assemblies can be added. (See pages 119 - 121)
- Chemical analysis and tensile tests performed on each PIC to verify chemistry and mechanical properties.
- Type Approval and certification in accordance with ABS 2007 Steel Vessel Rules 1-1-17.7, and ABS Guide for Certification of Cranes.
- Hoist hooks incorporate two types of strategically placed markings forged into the product which address two (2) QUIC-CHECK® features:
 - Deformation Indicators and Angle Indicators (see following page for detailed definition).

The following additional features have been incorporated in the new Crosby S-320N Eye Hoist Hooks. (Sizes 3/4 metric ton Carbon through 22 metric ton Alloy.)

- Metric Rated at 5:1 Design Factor for (Carbon Steel); 5:1 Design Factor for 1t - 22t (Alloy Steel).
- Can be proof tested to 2 times the working Load Limit.
- Low profile hook tip.
- New integrated latch (S-4320) meets the World class standard for lifting.
 - Heavy duty stamped latch interlocks with the hook tip.
 - High cycle, long life spring.
 - When secured with proper cotter pin through the hole in the tip of hook, meets the intent of OSHA Rule 1926.1431(g) and 1926.1501(g) for personnel hoisting.
- Fatigue rated at 1-1/2 times the Working Load Limit at 20,000 cycles.

Use 1-ton rated (min.)

Working Load Limit (t)		Hook ID Code	Eye Hook Stock No.			Weight Each (kg.)	Replacement Latch Kits		
Carbon	Alloy		Carbon S-320C S.C.	Carbon G-320CN Galv.	Alloy S-320A S-320AN S.C.		S-4320 Stock No.	PL Stock No.	SS-4055 Stock No.
0.75	1.25	†D	1022200	1022208	1022375	.28	1096325	-	-
1	1.6	†F	1022211	1022219	1022386	.40	1096374	-	-
1.5	2.5	†G	1022222	1022230	1022397	.65	1096421	-	-
2	3.2	†H	1022233	1022241	1022406	.94	1096468	-	-
3.2	5.4	†I	1022244	1022249	1022419	1.95	1096515	1092000	-
5	8	†J	1022255	1022262	1022430	3.76	1096562	1092001	-
7.5	11.5	†K	1022264	1022274	1022441	6.80	1096609	1092002	-
10	16	†L	1022277	1022285	1022452	9.42	1096657	1092003	-
15	22	†N	1022288	1022296	1022465	17.9	1096704	1092004	-
20	31.5	O	1023289	-	1023546	27.2	-	1093716	1090161
25	37	P	1023305	-	1023564	47.6	-	1093717	1090189
30	45	S	1023323	-	1023582	67	-	1093718	1090189
40	60	T	1023341	-	1023608	103	-	1093719	1090205

*Eye Hooks (3/4 TC - 22TA), Proof load is 2 times Working Load Limit. Eye Hooks (20 TC - 60TA). All carbon hooks-average straightening load (ultimate load) is 5 times Working Load Limit. Alloy eye hooks 1 ton through 22 ton-average straightening load (ultimate load) is 5 times Working Load Limit. Alloy eye hooks 30 tons through 60 tons-average straightening load (ultimate load) is 4.5 times Working Load Limit.

† New 320N style hook.

Grade 80 Alloy Chain

SPECTRUM 8® ALLOY CHAIN



- Alloy Steel.
- Heat Treated.
- Finish – Black rust preventative coating.
- Permanently embossed with CG (Crosby Group) and 8 (Grade).
- Proof Tested at 2 times the Working Load Limit with certification.

Minimum chain working load for Grade 80 is 7100 lb

Grade 80 Alloy Chain recommended for overhead lifting applications.

Chain Size (in.)	Spec. 8 Drum Stock No.	Feet Per Drum	Material Size (in.)	Working Load Limit (lbs.)*	Maximum Inside Length (in.)	Maximum Inside Width (in.)	Maximum Length 100 Links (in.)	Weight Per 100 Feet (lbs.)
9/32 (1/4)	273527	500	.276	3500	.87	.42	90	72
5/16	273536	500	.343	4500	1.01	.49	100	114
3/8	273545	500	.394	7100	1.23	.58	125	148
1/2	273554	300	.512	12000	1.57	.77	164	243
5/8	273563	200	.630	18100	1.93	.90	202	351
3/4	273572	100	.787	28300	2.42	1.14	252	584
7/8	273581	100	.866	34200	2.66	1.26	277	705
1	273590	75	1.024	47700	3.28	1.54	328	1041
1-1/4	273599	66	1.260	72300	4.03	1.89	403	1478

* Proof loaded at 2 times Working Load Limit. Ultimate Load is 4 times the Working Load Limit.

Crosby provides two methods of attaching Spectrum 8® chain to Crosby fittings.



A-1337
LOK-A-LOY®
Connecting Link
Refer to Page 202



S-1325
Grade 100
Coupler Link
Refer to Page 211

Main
Clearance Sale
Construction Equipment & Cab Enclosures
Custom Applications
Field Covers
General Purpose Tarps
School Applications
Military Installations
Pool Covers
Repair Work
Residential Products
Tents
Tent Accessories
Total Containment, Painting & Sand Blasting
Truck Tarpaulins
Truck Accessories
About Us
Contact Us

General Purpose Tarps

Teri Tarps, protecting the construction, agricultural, recreational, and transportation industries against the weather.




TERI GENERAL PURPOSE TARPS are rugged, water and mildew resistant canvas tarpaulins available in both regular and flame retardant materials.

TERI GENERAL PURPOSE TARPS, constructed from strong and flexible canvas, are completely dependable in any weather and for almost any purpose. They are available in many popular styles: OD, water and mildew resistant and OD Flame, water and mildew resistant, specially treated for applications requiring a flame retardant material.

Material

TERI OD: Rated 10 ounce canvas untreated; 18 ounce per sq. yd. treated. This Olive Drab canvas is the "old stand-by", proven in thousands of applications. Completely water and mildew-resistant.

TERI OD Flame: flame retardant, this material is very popular in the construction industry. 10 ounce canvas untreated, 18 ounce after treatment. Water and mildew resistant.



Available

- 10 oz. per sq. yd.
- 12oz. per sq. yd.
- 14.90 oz. per sq. yd.

Stock Sizes

- 15'x20'
- 20'x20'
- 20'x30'

All sizes are cut sizes before finishing. A 15' x 20' tarp will measure 14'4" x 19'6" minimum. Tarps are constructed of 6" material; allow for extra seams (2" per seam) on larger tarps.

*Special sizes available in request.

Appendix E


Standard Wire Rope

6x19 Class Wire Rope


- Strands:** 6
- Wires per strand:** 19 to 26
- Core:** IWRC or fiber core
- Standard Grade:** Purple Plus
- Lay:** Regular or Lang
- Finish:** Bright or galvanized

The 6x19 Classification of wire rope is the most widely used. With its good combination of flexibility and wear resistance, rope in this class can be suited to the specific needs of diverse kinds of machinery and equipment.


The 6x19 Seale construction, with its large outer wires, provides great ruggedness and resistance to abrasion and crushing. However, its resistance to fatigue is somewhat less than that offered by a 6x25 construction. The 6x25 possesses the best combination of flexibility and wear resistance in the 6x19 Class due to the filler wires providing support and imparting stability to the strand. The 6x26 Warrington Seale construction has a high resistance to crushing. This construction is a good choice where the end user needs the wear resistance of a 6x19 Class Rope and the flexibility midway between a 6x19 Class and 6x37 Class rope.

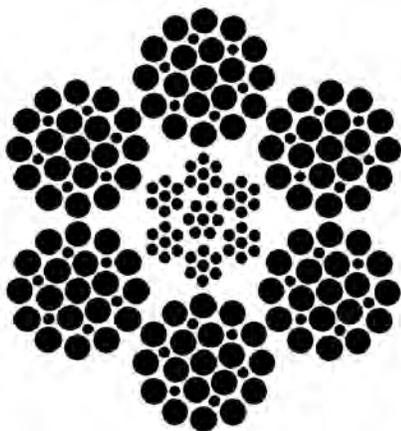


6x25 Filler Wire with IWRC

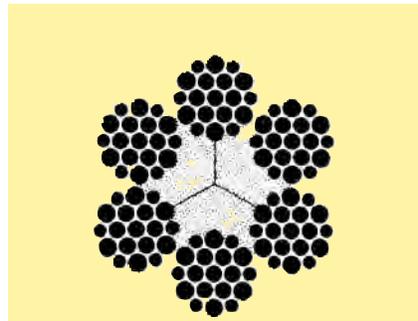


6x19 Warrington with fiber core




6x19 Seale with IWRC



6x26 Warrington Seale with IWRC



6x31 Warrington Seale with IWRC




6x49 Filler Wire Seale with IWRC

6x36 Class Wire Rope

- Strands:** 6
- Wires per strand:** 27 to 49
- Core:** IWRC or fiber core
- Standard Grade:** Purple Plus
- Lay:** Regular or Lang
- Finish:** Bright or galvanized

The 6x36 Class of wire rope is characterized by the relatively large number of wires used in each strand. Ropes of this class are among the most flexible available due to the greater number of wires per strand, however their resistance to abrasion is less than ropes in the 6x19 Class.

The designation 6x36 is only nominal, as in the case with the 6x19 Class. Improvements in wire rope design, as well as changing machine designs, have resulted in the use of strands with widely varying numbers of wires and a smaller number of available constructions. Typical 6x37 Class constructions include 6x33 for diameters under 1/2", 6x36 Warrington Seale (the most common 6x37 Class construction) offered in diameters 1/2" through 1-5/8", and 6x49 Filler Wire Seale over 1-3/4" diameter.

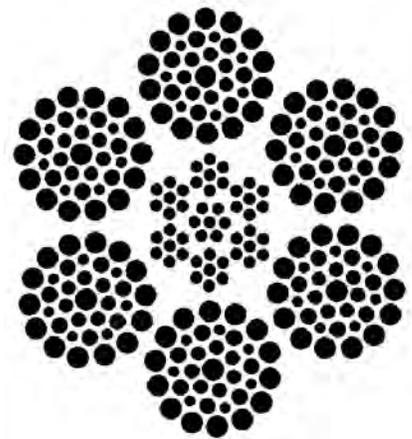

6x36 Warrington Seale IWRC



6x19 and 6x36 Classes Technical Data



6x19 Class

- 6x19 Seale
- 6x19 Warrington
- 6x21 Filler Wire Type U
- 6x21 Seale
- 6x25 Filler Wire Type W
- 6x25 Seale
- 6x26 Warrington Seale

Rope Diameter		Approx. Weight (lb./ft.)		Nominal Strength, tons (bright or drawn galvanized**)		
				Royal Purple		Purple Plus
inches	mm.	Fiber Core	IWRC	IWRC	Fiber Core	IWRC
1/4	6.5	0.11	0.12	3.74	3.01	3.40
5/16	8.0	0.16	0.18	5.80	4.69	5.27
3/8	9.5	0.24	0.26	8.30	6.71	7.55
7/16	11.0	0.32	0.35	11.2	9.10	10.2
1/2	13.0	0.42	0.46	14.6	11.8	13.3
9/16	14.5	0.53	0.58	18.5	14.9	16.8
5/8	16.0	0.66	0.72	22.7	18.4	20.6
3/4	19.0	0.85	0.91	29.1	23.2	25.9
7/8	22.0	1.29	1.41	43.8	35.4	39.8
1	26.0	1.68	1.85	56.9	46.0	51.7
1-1/8	29.0	2.13	2.34	71.5	57.9	65.0
1-1/4	32.0	2.63	2.89	87.9	71.1	79.9
1-3/8	35.0	3.18	3.49	106	85.5	96
1-1/2	38.0	3.78	4.16	125	101	114
1-5/8	42.0	4.44	4.88	146	118	132
1-3/4	45.0	5.15	5.66	169	136	153
1-7/8	48.0	5.91	6.49	192	155	174
2	52.0	6.73	7.39	217	176	198
2-1/8	54.0	7.60	8.34	243	197	221
2-1/4	58.0	8.52	9.35	272	220	247
2-3/8	60.0	9.49	10.4	301	244	274
2-1/2	64.0	10.5	11.6	332	269	302
2-3/4	70.0	12.7	14.0	397	321	361

**Galvanizing: For Class A galvanized wire rope (EIP grade only), deduct 10% from the nominal strength shown.



6x36 Class

- 6x31 Warrington Seale
- 6x33 Warrington Seale
- 6x36 Warrington Seale
- 6x41 Warrington Seale
- 6x43 Filler Wire Seale
- 6x49 Filler Wire Seale

Technical data for the above listed constructions are the same and are detailed in the table. For further information on additional constructions and diameters, contact WW's customer service department.

Appendix F

Scaffold Platform



BETH-ALLEN LADDER & EQUIPMENT Inc.

2124 West Broad Street Bethlehem, Pennsylvania 18018

1-800-835-4242

[Email Us](#)

610-866-4242


FAX: 610-866-3328



Aluminum Staging Task-Master® Stages

Ideal for the Jack applications, Swing stages, or catwalks

[Decorator Planks](#) * [Scaffold Planks](#) * [Stage Platforms](#) * [Guard Rail Systems](#)

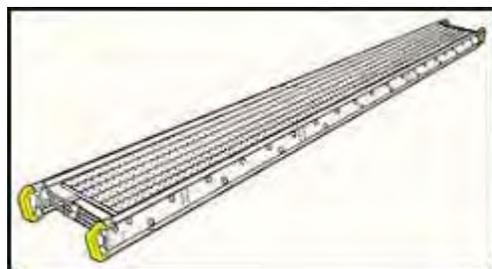

- Twist-Proof® Stage Design
- Individual slip-resistant decking minimizes paint or material build up.
- Double end rung provides extra rigidity on stages 20' or longer-standard on stages with 5" or 6" rails.
- Vinyl-coated end caps serve as hand grips and protect from sharp edges and surfaces marks.

DECORATOR PLANKS

1 Person 250 lbs. Rated

Model	Width	Side Rail Length	Side Rail Depth	Side Rail Flange	Ship Wt. lbs.
2008	12"	8'	4"	1-3/8"	25
2012	12"	12'	4"	1-3/8"	36
2016	12"	16'	4"	1-3/8"	48
2020	12"	20'	5"	1-3/8"	65
2024	12"	24'	5"	1-3/8"	78

SCAFFOLD PLANKS**2 Person - 500Lbs. Rated**

Model	Width	Side Rail Length	Side Rail Depth	Side Rail Flange	Ship Wt. lbs.
2316	12"	16'	4"	1-3/8"	48
2320	12"	20'	6"	1-3/8"	79
2324	12"	24'	6" HvyDty	1-3/8"	112
2328	12"	28'	6" HvyDty	1-3/8"	131
2330	12"	30'	6" HvyDty	1-3/8"	140
2332	12"	32'	6" HvyDty	1-3/8"	149
2408	14"	8'	4"	1-3/8"	27
2412	14"	12'	4"	1-3/8"	40
2416	14"	16'	5"	1-3/8"	58
2420	14"	20'	6"	1-3/8"	85
2424	14"	24'	6"	1-3/8"	109
2428	14"	28'	6"	2"	127
2430	14"	30'	6" HvyDty	2"	171
2432	14"	32'	6" HvyDty	2"	182

STAGE PLATFORMS**2 Persons - 500 Lbs. Rated**

Model	Width	Side Rail length	Side Rail Depth	Side Rail flange	Ship Wt. lbs.
2508	20"	8'	4"	1-3/8"	33.0
2512	20"	12'	4"	1-3/8"	48.0
2516	20"	16'	5"	1-3/8"	70.0
*2520	20"	20'	6"	1-3/8"	102.0
*2524	20"	24'	6"	1-3/8"	121.0
*2528	20"	28'	6"	2"	157.0
*2530	20"	30'	6"	2"	168.0
*2532	20"	32'	6"	2"	179.0
*2536	20"	36'	6" Hvy Dty	2"	243.0

*2539	20"	39'	6" Hvy Dty	2"	264.0
STAGE PLATFORMS 2 Persons - 500 Lbs. Rated					
2608	24"	8'	4"	1-3/8"	38.0
2612	24"	12'	4"	1-3/8"	56.0
2616	24"	16'	5"	1-3/8"	81.0
*2620	24"	20'	6"	1-3/8"	115.0
*2624	24"	24'	6"	1-3/8"	138.0
*2628	24"	28'	6"	2"	168.0
*2630	24"	30'	6"	2"	180.0
*2632	24"	32'	6"	2"	191.0
2708	28"	8'	4"	1-3/8"	41.0
2712	28"	12'	4"	1-3/8"	60.0
2716	28"	16'	5"	1-3/8"	87.0
*2720	28"	20'	6"	1-3/8"	124.0
*2724	28"	24'	6"	1-3/8"	147.0
*2728	28"	28'	6"	2"	187.0
*2732	28"	32'	6"	2"	213.0
STAGE PLATFORMS 3 Person - 750 lbs. Rated					
3112	24"	12'	4"	2"	64.0
3116	24"	16'	5"	2"	92.0
*3120	24"	20'	6"	2"	115.0
*3124	24"	24'	6" Hvy Dty	2"	145.0
*3128	24"	28'	6" Hvy Dty	2"	204.0
*3132	24"	32'	6" Hvy Dty	2"	236.0
*3136	24"	36'	6" Hvy Dty	2"	323.0
*3139	24"	39'	6" Hvy Dty	2"	365.0
STAGE PLATFORMS 3 Person - 750 lbs. Rated					
3208	28"	8'	4"	2"	48.0

Appendix G

Ventilation System

	Subject: Abrasive Blasting Containment Plans		
	Eleven Bridges on I-91, County of Windsor, Vermont		
Comp by: MAT	Date: 02/08/16	Sheet Number: _____	
Check by: PRS	Job No: 187-18-1		

Dust Collector/Fan Ventilation System :

The contractor shall provide mechanical exhaust ventilation for the abrasive blasting containment structures using one or more mobile dust collectors. The contractor proposes to use one (1) 45,000 cfm at 13" W.G. mobile dust collector manufactured by Advanced Recycling Systems, Inc. The dust collector has an assumed dust exhaust capacity based on the number of ducts provided.

Using an iterative process and estimated friction loss for 20" diameter ducts from friction loss curves, use:

4 - 20 inch diameter ducts

Max. Exhaust capacity =	48000	cfm total,	or	12000	cfm per duct
Total Estimated system static pressure =	9.46	inch water gage (from fan curve)			
Friction loss per 100 ft of duct =	2.0	Inch W.G. (from friction loss curve for 20" ducts)			
Maximum number of elbows =	3	Each (46 equivalent linear feet per elbow)			
loss thru containment =	1.20	inch water gage (typical)			
loss thru fabric filters =	4.00	inch water gage (typical)			
loss thru elbows =	2.76	inch water gage (calculated)			
loss thru duct =	1.50	inch water gage (remaining)			
Maximum Length of Duct =	75.0	ft (max allowed for system)			

3 - 20 inch diameter ducts

Max. Exhaust capacity =	45000	cfm total,	or	15000	cfm per duct
Total Estimated system static pressure =	12.25	inch water gage (from fan curve)			
Friction loss per 100 ft of duct =	2.8	Inch W.G. (from friction loss curve for 20" ducts)			
Maximum number of elbows =	3	Each (46 equivalent linear feet per elbow)			
loss thru containment =	1.20	inch water gage (typical)			
loss thru fabric filters =	4.00	inch water gage (typical)			
loss thru elbows =	3.86	inch water gage (calculated)			
loss thru duct =	3.19	inch water gage (remaining)			
Maximum Length of Duct =	113.8	ft (max allowed for system)			

2 - 20 inch diameter ducts

Max. Exhaust capacity =	40000	cfm total,	or	20000	cfm per duct
Total Estimated system static pressure =	16.00	inch water gage (from fan curve)			
Friction loss per 100 ft of duct =	4.5	Inch W.G. (from friction loss curve for 20" ducts)			
Maximum number of elbows =	3	Each (46 equivalent linear feet per elbow)			
loss thru containment =	1.20	inch water gage (typical)			
loss thru fabric filters =	4.00	inch water gage (typical)			
loss thru elbows =	6.21	inch water gage (calculated)			
loss thru duct =	4.59	inch water gage (remaining)			
Maximum Length of Duct =	102.0	ft (max allowed for system)			

1 - 20 inch diameter ducts

Max. Exhaust capacity =	24000	cfm total,	or	24000	cfm per duct
Total Estimated system static pressure =	17.50	inch water gage (from fan curve)			
Friction loss per 100 ft of duct =	5.5	Inch W.G. (from friction loss curve for 20" ducts)			
Maximum number of elbows =	3	Each (46 equivalent linear feet per elbow)			
loss thru containment =	1.20	inch water gage (typical)			
loss thru fabric filters =	4.00	inch water gage (typical)			
loss thru elbows =	7.59	inch water gage (calculated)			
loss thru duct =	4.71	inch water gage (remaining)			
Maximum Length of Duct =	85.6	ft (max allowed for system)			

If the cross sectional area is exceeded in the shop drawings or required air flow is not achieved, contractor shall provide additional dust collectors and exhaust ducts or reduce the size of the active paint containment enclosure by installing internal tarpaulin walls.

	Subject: Abrasive Blasting Containment Plans Eleven Bridges on I-91, County of Windsor, Vermont		
	Comp by: MAT Check by: PRS	Date: 02/08/16 Job No: 187-18-1	Sheet Number: _____

Containment Design Parameters:

Provide a minimum cross-draft ventilation of 100 - 300 ft/min (Coating Structural Steel- Containment System 561.10-3)
 Provide a minimum down-draft ventilation of 60 ft/min
 Size the inlets to provide air flow velocity of 700 - 1,000 ft/min

Ventilation System Cross-Draft:

20" diam. Ducts, No. Required =	4	3	2	1	
Volume Q =	48,000	45,000	24,000	20,000	cfm
Max. Containment Area (V = 100 ft/min)	480.0	450.0	240.0	200.0	ft ²
Min. Containment Area (V = 300 ft/min)	160.0	150.0	80.0	66.7	ft ²
Max. Inlet Area (V = 700 ft/min)	68.6	64.3	34.3	28.6	ft ²
Min. Inlet Area (V = 1000 ft/min)	48.0	45.0	24.0	20.0	ft ²

Sample Calculation:


Max. Containment Area = Q/V = 48000 cfm / 100 ft/min = 480.0 ft²

Min. Containment Area = Q/V = 48000 cfm / 300 ft/min = 160.0 ft²

Max. Inlet Area = Q/V = 48000 cfm / 700 ft/min = 68.6 ft²

Min. Inlet Area = Q/V = 48000 cfm / 1000 ft/min = 48.0 ft²


ADVANCED RECYCLE SYSTEMS, INC.
MODEL ARS-45 MOBILE DUST COLLECTOR

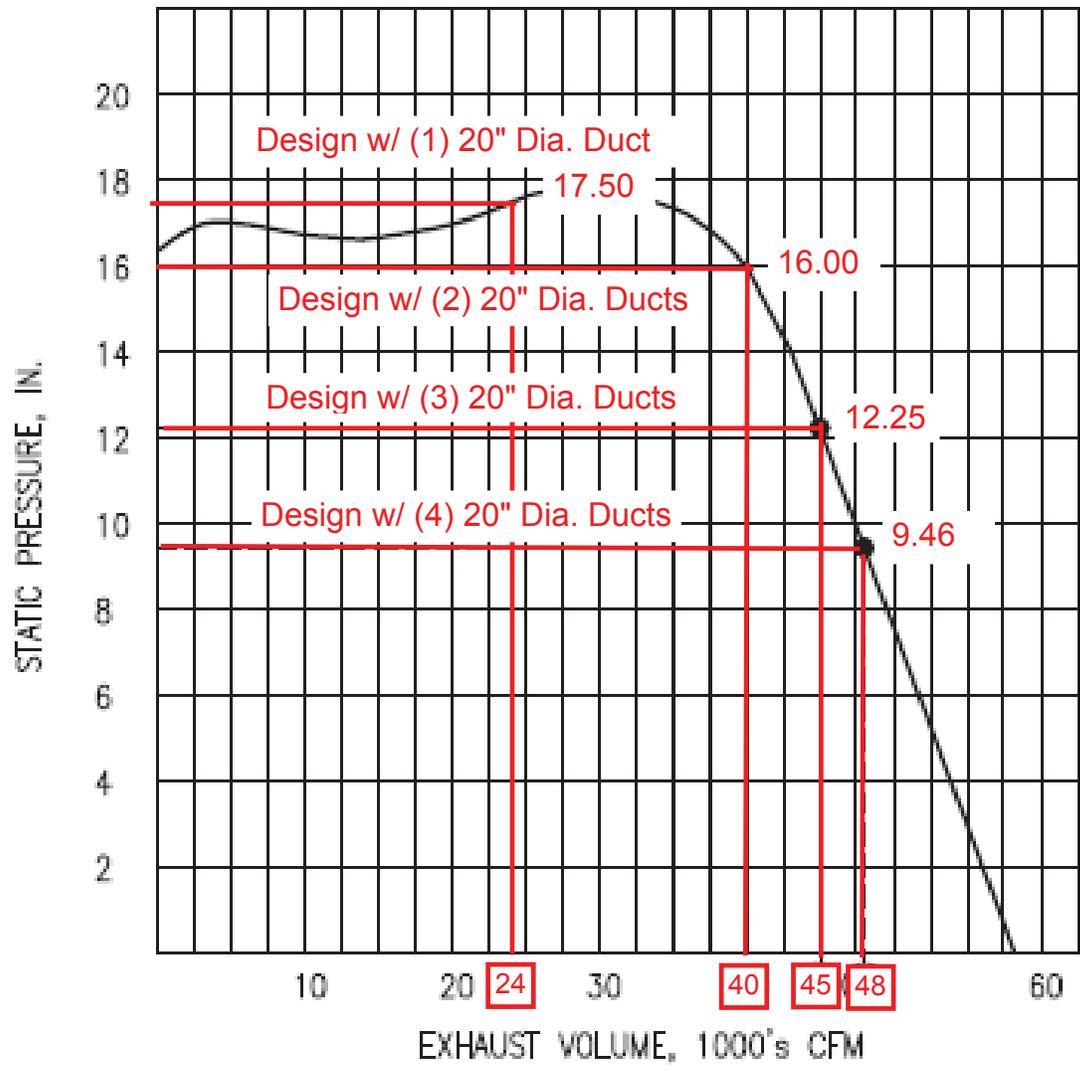

DUST COLLECTOR FAN CURVE

MAX. AVAILABLE EXHAUST CAPACITY W/4 DUCTS	48,000 CFM
MAX. AVAILABLE EXHAUST CAPACITY W/3 DUCTS	45,000 CFM
MAX. AVAILABLE EXHAUST CAPACITY W/2 DUCTS	40,000 CFM
MAX. AVAILABLE EXHAUST CAPACITY W/1 DUCT	24,000 CFM

Estimated Friction Loss for
20" diameter exhaust ducts

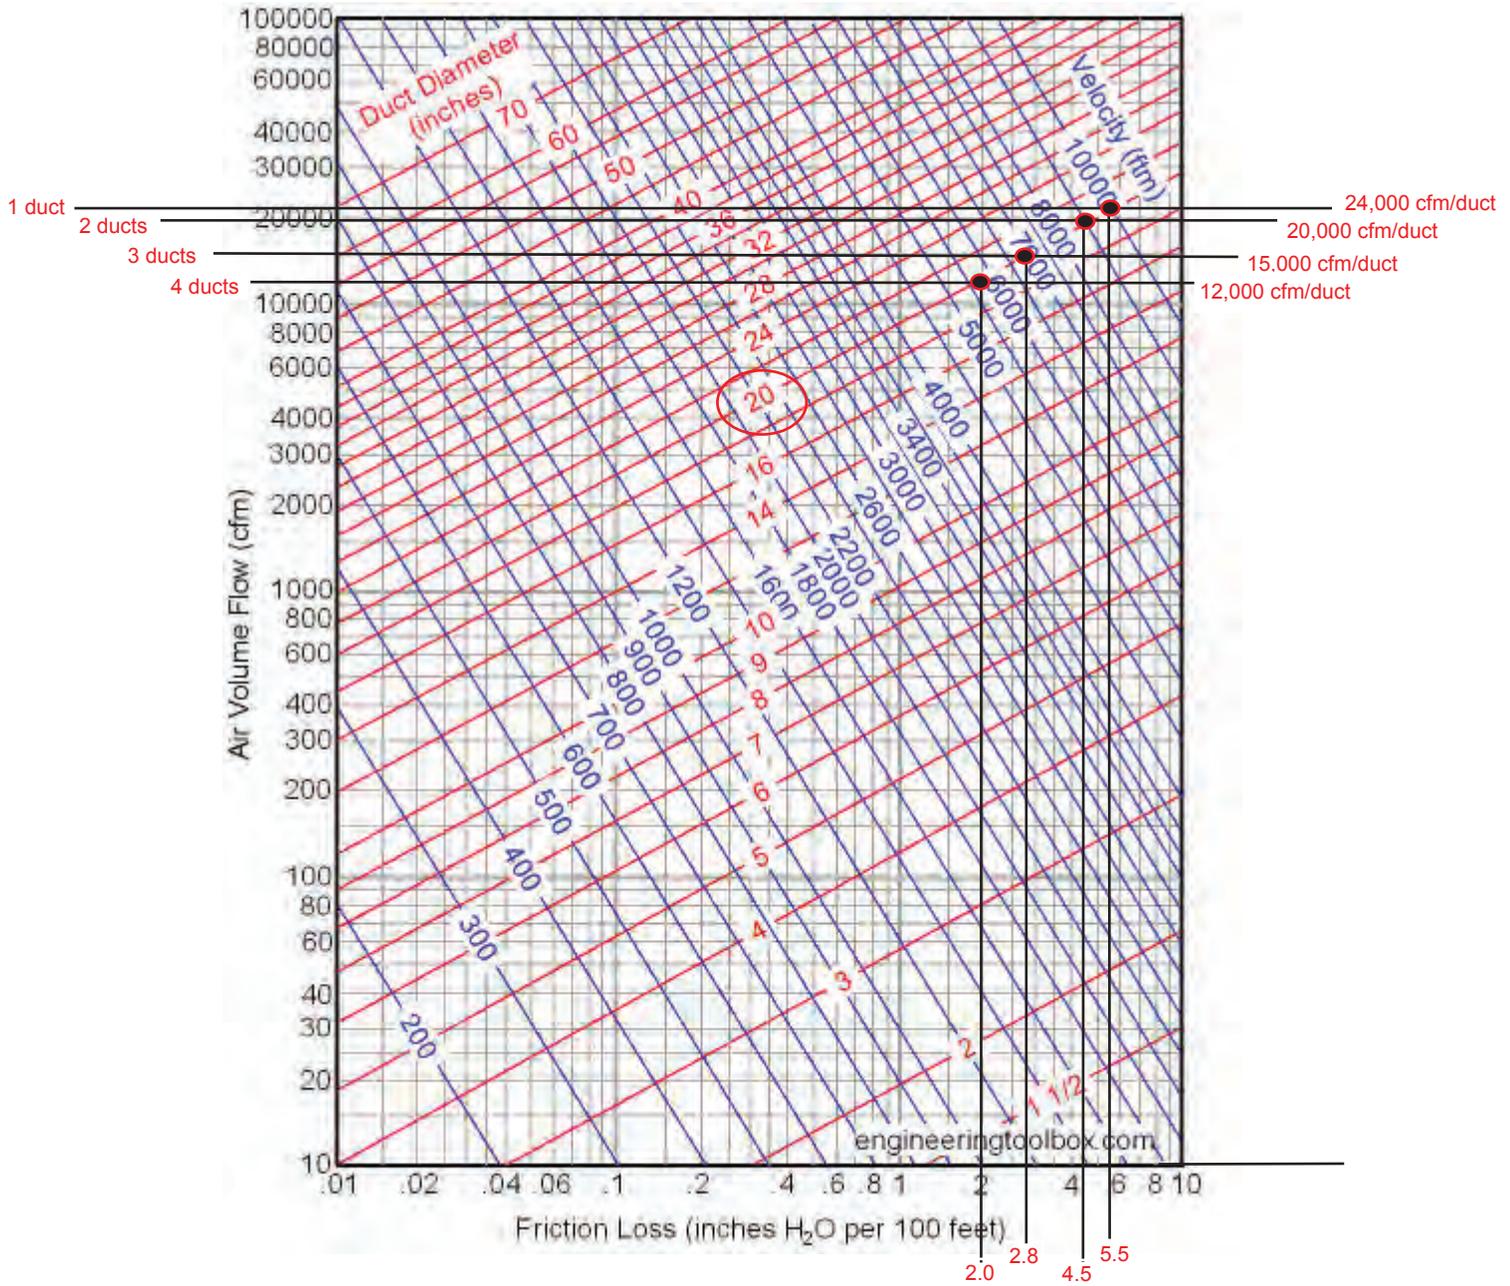



Advanced Recycling Systems, Inc.

Designers and Builders of Mobile Blasting Systems

1089 N. HUBBARD ROAD • LOWELLVILLE, OHIO 44436-9737 • Tel. (330) 534-3330 • FAX (330) 534-9249

45,000 CFM Dust Collector at 13" Wg.



- **Hydraulic Auger**
- **Only 28 ft. long**
- **Long Life Filter Cartridges**

Low Drag-High Airflow Design



Advanced Recycling Systems, Inc.

Designers and Builders of Mobile Blasting Systems

1089 N. HUBBARD ROAD • LOWELLVILLE, OHIO 44436-9737 • Tel. (330) 534-3330 • FAX (330) 534-9249

45,000 CFM Dust Collector

S P E C I F I C A T I O N S

AIR RATE PER UNIT	45,000 CFM @ 13 Wg. 40,000 CFM @ 16 Wg.
CARTRIDGE EFFICIENCY	99.9% @ 0.5 microns
ARRANGEMENT OF ELEMENTS	Vertical
CARTRIDGE CLEANING	Ram Injection, Pulse Type
NUMBER OF CARTRIDGES	84
FILTER MEDIA AREA	12,600 sq. ft.
AIR-TO-CLOTH RATIO	3.5 TO 1 @ 45,000 CFM 3.1 TO 1 @ 40,000 CFM
DUCTING CONNECTIONS	4 @ 20" Dia.
FAN	Class IV Non-overloading Type "C" Spark Resistant
DRIVE	Banded V-Belt with clutch
TYPE OF ENGINE	165 H.P. Diesel
FUEL TANK	90 Gallon
AUGER DRIVE	Hydraulic
TRAILER	28' L x 8" W x 12'3" H
BRAKES	Electric
OPTIONS:	Dual Rear Inlets

Specifications are subject to change without notice so that improvements can be affected as quickly as possible.

Nothing contained in this brochure is intended to extend any warranty or representation, expressed or implied, regarding the products described herein.

**COATING EXISTING STRUCTURAL STEEL – CONTAINMENT SYSTEM.
(REV 11-16-11)**

SUBARTICLE 561-10.3 (of the Supplemental Specifications) is deleted and the following substituted:

561-10.3 Containment System: Submit a written containment system design plan in accordance with this section and the contract documents at the pre-construction conference or as directed by the Engineer which clearly describes the proposed containment system applicable to the intended removal method and in accordance with the requirements outlined herein and SSPC Guide 6, Guide for Containing Debris Generated During Paint Removal Activities. Ensure the plan includes, but is not limited to, removal method; methods for collecting debris; and containment enclosure components. Use fire retardant materials. Provide containment drawings, calculations, assumptions, ventilation criteria if applicable, and a structural analysis that verifies the existing structure can withstand the additional dead, live and wind loads imposed by the containment system, signed and sealed by a Specialty Engineer. However, for more complex structures incorporating cables stayed, suspension, or truss designs, the analysis must be performed by the Contractor's Engineer of Record qualified in Type Work Category 4.3, Complex Bridge Design. Provide a contingency plan addressing natural weather events such as tropical storms and hurricanes. Ensure the lighting inside the containment is in accordance with SSPC Guide 12, Guide for Illumination of Industrial Painting Projects. Provide lighting to a minimum intensity of 10 ft-cd for general, 20 ft-cd for work, and 50 ft-cd for inspection. All drawings and calculations must be submitted and accepted before any work begins. Include a clear description of the ventilation system components and information including the fan curve and design point on the proposed dust collector. Design to provide ventilation according to the notes provided in SSPC Guide 6: 100 feet per minute for cross draft and 50-60 feet per minute for downdraft.

Isolate the immediate area of the structure to ensure compliance with current and permit requirements for air, water, soil, and pollution prevention. Protect the containment system from vehicular and pedestrian traffic. Ensure paint, paint chips, or other debris will not fall outside of the containment area under any circumstances. Repair any damage created by fastening, bracing, or handling the scaffolding and staging. If a suspended platform is constructed, use rigid or flexible materials as needed to create an air and dust impenetrable enclosure. Verify that the platform and its components are designed and constructed to support at least four times its maximum intended load without failure, with wire cables capable of supporting at least six times their maximum intended load without failure. Strictly comply with all applicable OSHA regulations regarding scaffolding. The category and class of containment shall be as required in the Contract Documents.