REINFORCED ELASTOMERIC BEARING FABRICATION SHEET 1103- Page #: 1

Project #: 39022-1103-1 (16 OF 16) Customer: PARENT CONSTRUCTION

County: ADDISON State: VT Structure: 23

Pad I.D./Loc.: ABUTMENTS Quantity (Including Full Size Sample(s) - If Req'd): 16

Certifications Are Required — Testing Req'd: ☐ YES, see below ☑ NO, random in-house only VDOT 2011 — Sample Req'd: ☐ YES - (If not full size, create another sheet) ☑ NO

State D.O.T. Spec. Number (If Specified): SEC 531 & 731 Project # (req'd for cert.s) ER BRF 0174(16)

Special Notes:

Shim Steel Spec. (Circle One): A709 GR.36(250) (A1011 GR.36(250)-Type 1) Other:

Durometer Requirement (Circle One): ~~50±5~~ ~~60±5~~ Other: — Shear Modulus Requirement: 100psi ±15%

Neoprene Grade (Circle One): 3 (4) Other Grade or Natural Rubber: NATURAL RUBBER

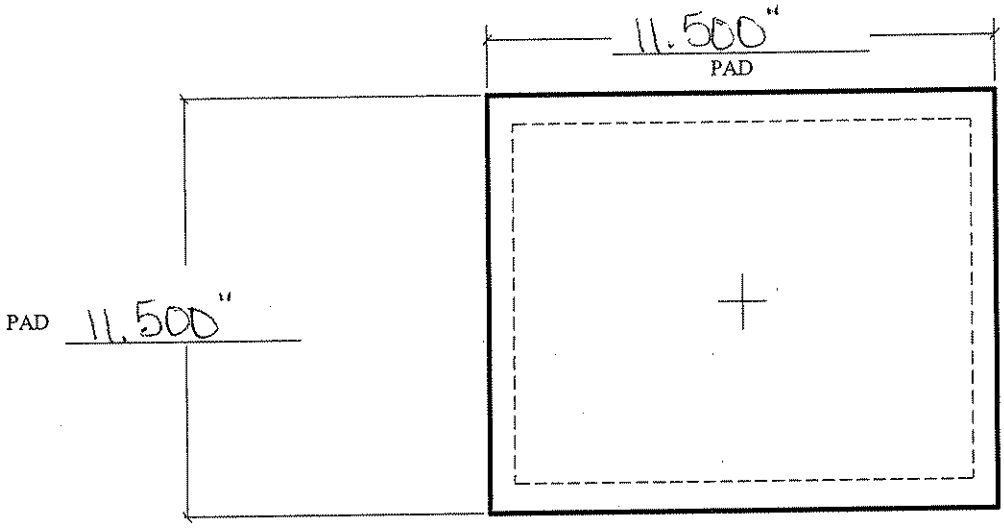

Vermont Agency of Transportation
RECEIVED
CK'D BY JTS OK'D BY WDL
January 10th, 2013
RESUBMIT BY KMH APPROVED X DATE 1-10-13

Please verify the use of 14 GA shims in lieu of 16 GA shims.

(A) PLAN
NOT TO SCALE

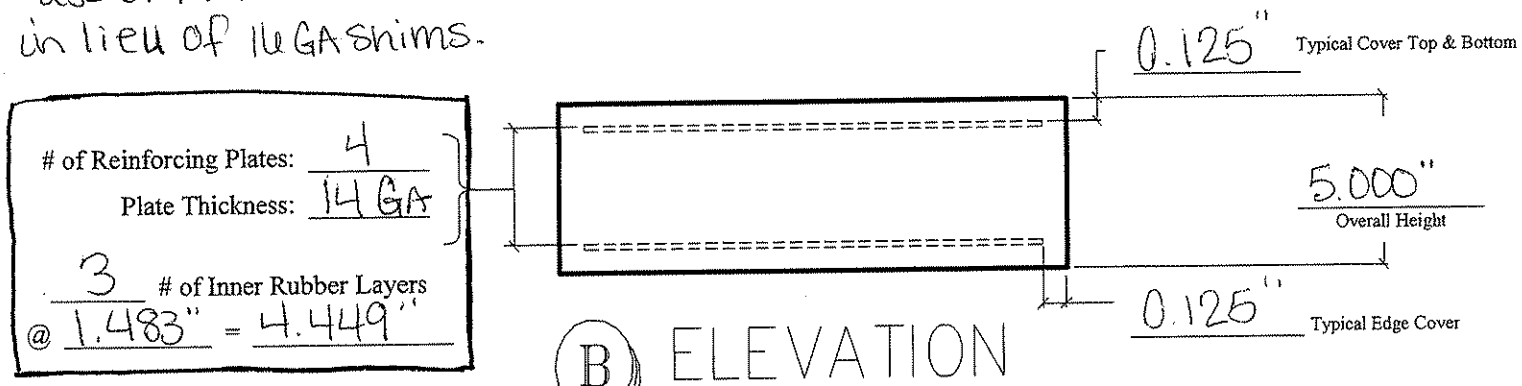

(B) ELEVATION
NOT TO SCALE

Name: Natasha Ortiz Date: 1-10-13

This shop drawing was prepared in accordance with the contract plans and specifications. The D.S. Brown Company does not accept liability for the design of the products detailed in the shop drawings.

The D.S. Brown Company • 300 East Cherry Street • North Baltimore, Ohio 45872-0158
Phone: (419) 257-3561 • Fax: (419) 257-2200