

KUBRICKY CONSTRUCTION CORP.
269 BALLARD ROAD

WILTON, NY 12831
518 792-5864



KUBRICKY CONSTRUCTION CORP.
A PROUD MEMBER OF THE D.A. COLLINS™ COMPANIES
An Equal Opportunity Employer

Rutland City BRF 3000 (2014036)
SUBMITTAL 39

Issued 03/20/15
Respond by 04/03/15

To

Timothy Pockette, PE

Topic 629.39 Corporation Stop 1"
Status For Approval
Spec section 629.39
Responsibility (16) River St
Sent to approver 3/20/15
Required from approver 4/3/15

From

Volker H.D. Burkowski

Signed by


Date

3/20/15

Proceed as Indicated

Date


Owner Authorized Representative



SUBMITTAL INFORMATION

Ballcorp Corporation Stops - (FB1000-4-G-NL style)

AWWA/CC TAPER THREAD INLET BY GRIP JOINT FOR COPPER OR PLASTIC TUBING (CTS) OUTLET

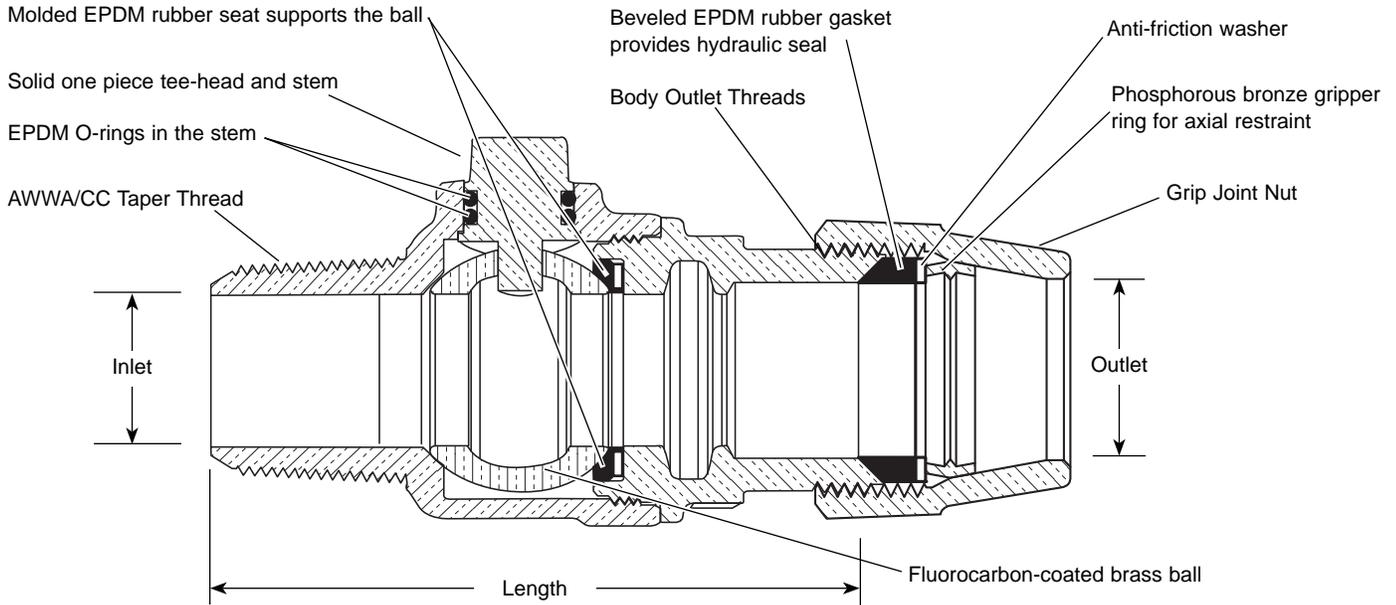

VALVE SIZE	INLET SIZE	OUTLET SIZE	VALVE LENGTH	BODY OUTLET THREADS	APPROX. WT. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
1"	1"	1"	4-1/2"	1" Flare Copper	2.6	FB1000-4-G-NL	



Note: Ford recommends using insert stiffeners with plastic pipe or tubing.

- ### FEATURES
- All brass that comes in contact with potable water conforms to AWWA standard C800 (UNS NO C89833)
 - Brass components that do not come in contact with potable water conform to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
 - The product has the letters "NL" cast into the main body for proper identification
 - UL Classified to ANSI/NSF Standard 61 and Annex G
 - Ends are integral or secured with adhesive to prevent unintentional disassembly
 - 300 PSI working pressure

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.

FORD
The Ford Meter Box Company, Inc.
 P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
 Phone: 260-563-3171 / Fax: 800-826-3487
 Overseas Fax: 260-563-0167
<http://www.fordmeterbox.com>

08/18/10

Submitted By: _____