


This item needs to meet all section of section 540, need reinforcing steel detailing, need concrete mix design, lifting mechanism

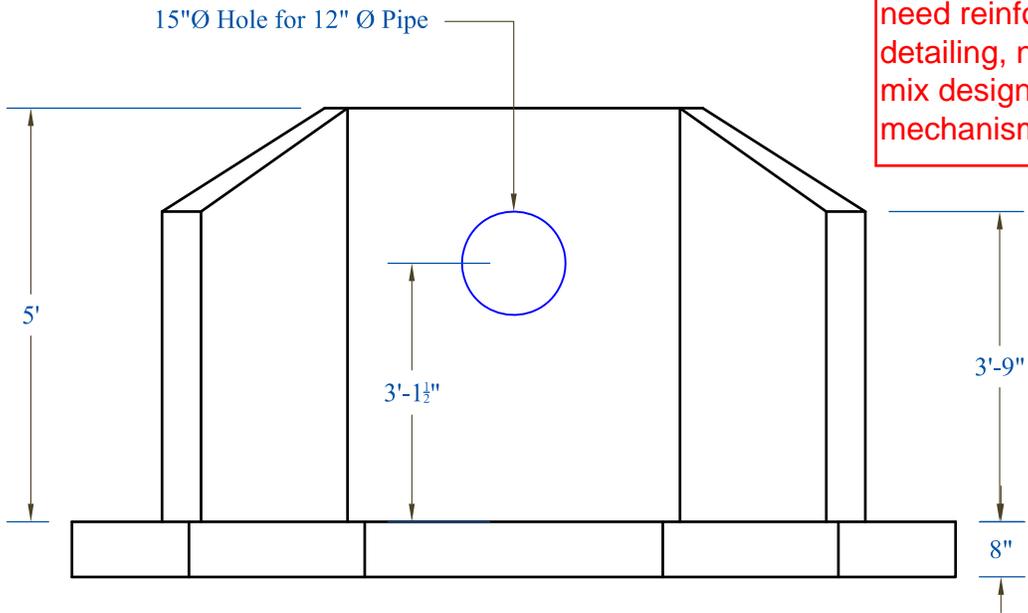

Elevation View

Vermont Agency of Transportation
RECEIVED
 CK'D BY MEM OK'D BY
 Apr. 24, 2015
 RESUBMIT
 BY C. Carlson DATE 04-10-2015

6800 lbs.

Job #: 15790
 Company: Champlain Constr.
 Project: River St. BRF3000(16)
 Address: Rutland, VT
 Date: 02/03/15
 Scale: N.T.S.

Design Notes:
 -Concrete Minimum 5000 psi at 28 days
 -Grade 60 Steel Reinforcing